



EVALUATION REPORT

FLORIDA BUILDING CODE, 8TH EDITION (2023)

Manufacturer: JOHNS MANVILLE CORPORATION
 P.O. Box 5108
 Denver, CO 80217
 (303) 978-2478
www.jm.com

Issued April 3, 2024

Manufacturing Plants: Southgate, CA
 Oklahoma City, OK
 Macon, GA

Quality Assurance: UL LLC (QUA9625)

SCOPE

Category: Roofing
Subcategory: Modified Bitumen Roof System
Code Edition: Florida Building Code, 8th Edition (2023)
Code Sections: 1504.3.1, 1504.6, 1507.2.9.2, 1507.10.2, 1507.11.2,
Properties: Wind Resistance, Physical Properties

PRODUCT DESCRIPTION

Products	Specification	Description
JM APP Base	ASTM D 6509	APP modified asphalt, fiberglass reinforced, smooth surfaced base sheet.
APPeX 4S	ASTM D 6222	APP modified asphalt, polyester reinforced, smooth surfaced membrane for use as a Base or Ply sheet only.
APPeX 4S Embossed	ASTM D 6222	APP modified asphalt, polyester reinforced, smooth surfaced membrane for use as a Base or Ply sheet only.
APPeX 4.5 M	ASTM D 6222	APP modified asphalt, polyester reinforced, mineral surfaced membrane.
APPeX 4.5 M FR	ASTM D 6222	APP modified asphalt, polyester reinforced, fire-retardant, mineral surfaced membrane.
APPeX 4.5M CR G	ASTM D 6222	APP modified asphalt, polyester reinforced, surfaced with reflective roofing granules.
APPeX 4.5M FR CR G	ASTM D 6222	APP modified asphalt, polyester reinforced, fire-retardant, surfaced with reflective roofing granules.
Bicor S	ASTM D 6223	APP modified asphalt, polyester/glass reinforced, smooth surfaced membrane for use as a Base or Ply sheet only.
Bicor M FR	ASTM D 6223	APP modified asphalt, polyester/glass reinforced, granule surfaced membrane.
DynaBase HW	ASTM D 6163	A glass reinforced SBS modified bitumen base sheet for heat welded applications.
DynaFast 180 HW	ASTM D 6164	A polyester reinforced SBS modified bitumen base or inner ply sheet for use in heat weld applications.
DynaFast 180 S	ASTM D 6164	A polyester reinforced SBS modified bitumen base or inner ply sheet.
DynaFast 250 HW	ASTM D 6164	A polyester reinforced SBS modified bitumen base or inner ply sheet for use in heat weld applications.
DynaGrip Base SD/SA	ASTM D 4601	Self-adhering, asphalt impregnated and coated glass fiber base sheet for use in conventional and modified bitumen built-up roofing.
DynaGrip Base PR SD/SA	ASTM D 6164	Self-adhering, asphalt impregnated and coated polyester base sheet for use in conventional and modified bitumen built-up roofing.



Products	Specification	Description
DynaWeld 250 S	ASTM D 6164	A polyester reinforced SBS modified bitumen base or inner ply sheet for use in heat weld applications.
GlasBase Plus	ASTM D 4601	Type II asphalt impregnated and coated glass fiber base sheet for use in conventional and modified bitumen built-up roofing.
GlasPly IV	ASTM D 2178	Type IV asphalt impregnated glass felt for use in conventional and modified bitumen built-up roofing.
GlasPly Premier	ASTM D 2178	Type VI asphalt impregnated glass felt for use in conventional and modified bitumen built-up roofing.
PermaPly 28	ASTM D 4601	Type II asphalt impregnated and coated glass fiber base sheet for use in conventional and modified bitumen built-up roofing.
Tricor M FR	ASTM D 6223	APP modified asphalt, polyester/glass reinforced, granule surfaced membrane.
Tricor M FR CR	ASTM D 6223	APP modified asphalt, polyester/glass reinforced, coated granule surfaced membrane.
Tricor S	ASTM D 6223	APP modified asphalt, polyester/glass reinforced, smooth surfaced membrane for use as a Base or Ply sheet only.
Ventsulation Felt	ASTM D 4897	Heavy duty fiber glass base sheet impregnated and coated on both sides with asphalt with or without fine mineral stabilizer. Surfaced on the bottom side with coarse mineral granules embedded in asphaltic coating.

REFERENCES

<u>Entity</u>	<u>Report No.</u>	<u>Standards (Year)</u>
FM Approvals (TST1867)	0V7A4.AM	FM 4470 (2016)
FM Approvals (TST1867)	0W6A2.AM	FM 4470 (2016)
FM Approvals (TST1867)	0X0A9.AM	FM 4470 (2016)
FM Approvals (TST1867)	0X7A4.AM	FM 4470 (2016)
FM Approvals (TST1867)	3001482	FM 4470 (2016)
FM Approvals (TST1867)	3002823	FM 4470 (2016)
FM Approvals (TST1867)	3003468	FM 4470 (2016)
FM Approvals (TST1867)	3007148	FM 4470 (2016)
FM Approvals (TST1867)	3009499	FM 4470 (2016)
FM Approvals (TST1867)	3011248	FM 4470 (2016)
FM Approvals (TST1867)	3012974	FM 4470 (2016)
FM Approvals (TST1867)	3037540	FM 4470 (2016)
FM Approvals (TST1867)	3043824	FM 4470 (2016)
FM Approvals (TST1867)	3052113	FM 4470 (2016)
FM Approvals (TST1867)	3056303	FM 4470 (2016)
FM Approvals (TST1867)	3063554	FM 4470 (2016)
FM Approvals (TST1867)	PR450753	FM 4470 (2016)
FM Approvals (TST1867)	PR453769	FM 4470 (2016)
FM Approvals (TST1867)	PR454134	FM 4470 (2016)
FM Approvals (TST1867)	PR459758	FM 4470 (2016)
FM Approvals (TST1867)	PR461495	FM 4470 (2016)
FM Approvals (TST1867)	RR229337	FM 4470 (2016)
FM Approvals (TST1867)	RR229341	FM 4470 (2016)
FM Approvals (TST1867)	RR230185	FM 4470 (2016)
FM Approvals (TST1867)	RR232747	FM 4470 (2016)
FM Approvals (TST1867)	RR233717	FM 4470 (2016)
FM Approvals (TST1867)	RR234327	FM 4470 (2016)
FM Approvals (TST1867)	RR460477	FM 4470 (2016)
Nemoj Etc LLC (TST6049)	4a-CEL-19-LSWUS-01.C	FM 4474 (2011)
Nemoj Etc LLC (TST6049)	4a-CEL-22-LSWUS-.01A	FM 4474(B) (2011)
Nemoj Etc LLC (TST6049)	4a-JM-23-LSWUS-02.A	UL 1897 (2015)
PRI Construction Materials Technologies (TST5878)	JMC-030-02-01	ASTM D 5147 (2014) ASTM D 6222 (2016)

<u>Entity</u>	<u>Report No.</u>	<u>Standards (Year)</u>
PRI Construction Materials Technologies (TST5878)	JMC-030-02-02	ASTM D 5147 (2014) ASTM D 6222 (2016)
PRI Construction Materials Technologies (TST5878)	JMC-030-02-03	ASTM D 5147 (2014) ASTM D 6222 (2016)
PRI Construction Materials Technologies (TST5878)	JMC-053-02-01	ASTM D 5147 (2014) ASTM D 6222 (2016)
PRI Construction Materials Technologies (TST5878)	JMC-054-02-01	ASTM D 5147 (2014) ASTM D 6223 (2016)
PRI Construction Materials Technologies (TST5878)	JMC-055-02-01	ASTM D 6509 (2016)
PRI Construction Materials Technologies (TST5878)	JMC-070-02-01	ASTM D 2178 (2015a)
PRI Construction Materials Technologies (TST5878)	JMC-072-02-02	ASTM D 4601 (2004(2012)E1)
PRI Construction Materials Technologies (TST5878)	JMC-074-02-01	ASTM D 4897 (2016a)
PRI Construction Materials Technologies (TST5878)	JMC-075-02-04.2	ASTM D 6164 (2016) ASTM G 155 (2013)
PRI Construction Materials Technologies (TST5878)	JMC-093-02-01	ASTM D 4601 (2004(2012)E1)
PRI Construction Materials Technologies (TST5878)	JMC-106-02-01	ASTM D 6164 (2016)
PRI Construction Materials Technologies (TST5878)	JMC-107-02-01.11	ASTM D 903 (1998(2010)) ASTM D 1876 (2008(2015)e1) ASTM D 5147 (2014) TAS 117(A & B) (1995) TAS 114(C) (1995)
PRI Construction Materials Technologies (TST5878)	JMC-108-02-01	FM 4474 (D) (2011)
PRI Construction Materials Technologies (TST5878)	JMC-113-02-01	ASTM D 6164 (2016)
PRI Construction Materials Technologies (TST5878)	JMC-114-02-01	FM 4474 (D) (2011)
PRI Construction Materials Technologies (TST5878)	JMC-118-02-02	FM 4474 (C) (2011)
PRI Construction Materials Technologies (TST5878)	JMC-126-02-01	FM 4474 (D) (2011)
PRI Construction Materials Technologies (TST5878)	JMC-131-02-01	FM 4474 (D) (2011)
PRI Construction Materials Technologies (TST5878)	JMC-132-02-01	FM 4474 (B) (2011)
PRI Construction Materials Technologies (TST5878)	JMC-141-02-01	FM 4474 (D) (2011)
PRI Construction Materials Technologies (TST5878)	JMC-167-02-01	FM 4474 (C) (2011)
PRI Construction Materials Technologies (TST5878)	JMC-168-02-01	FM 4474 (D) (2011)
PRI Construction Materials Technologies (TST5878)	JMC-222-02-01	FM 4474 (D) (2011)
PRI Construction Materials Technologies (TST5878)	JMC-222-02-02	FM 4474 (D) (2011)
PRI Construction Materials Technologies (TST5878)	JMC-222-02-04	FM 4474 (D) (2011)
PRI Construction Materials Technologies (TST5878)	JMC-242-02-01	FM 4474 (D) (2011)
PRI Construction Materials Technologies (TST5878)	JMC-245-02-01	FM 4474 (D) (2011)
PRI Construction Materials Technologies (TST5878)	JMC-267-02-01	UL 1897 (2012) FM 4474 (D) (2011) UL 1897 (2012)
PRI Construction Materials Technologies (TST5878)	JMC-272-02-01	FM 4474 (D) (2011) UL 1897 (2015)
PRI Construction Materials Technologies (TST5878)	JMC-337-02-01	ASTM D 4601 (2004(2012)E1)
PRI Construction Materials Technologies (TST5878)	507T0144A	FM 4474 (C) (2011)
PRI Construction Materials Technologies (TST5878)	507T0153	ASTM D 5147 (2014) ASTM D 6222 (2016)
PRI Construction Materials Technologies (TST5878)	507T0153A	FM 4474 (C) (2011)
PRI Construction Materials Technologies (TST5878)	507T0155	FM 4474 (B) (2011)
PRI Construction Materials Technologies (TST5878)	507T0187.2	TAS 117(A & B) (1995) FM 4470 (2016)
PRI Construction Materials Technologies (TST5878)	JMC-071-02-01	ASTM D 2178 (2015a)
PRI Construction Materials Technologies (TST5878)	507T0009	FM 4474 (C) (2011)
PRI Construction Materials Technologies (TST5878)	507T0031	FM 4474 (C) (2011)
PRI Construction Materials Technologies (TST5878)	507T0224	FM 4474 (D) (2011);
PRI Construction Materials Technologies (TST5878)	507T0236	FM 4474 (C) (2011)
PRI Construction Materials Technologies (TST5878)	507T0222	ASTM D 6164 (2016)
PRI Construction Materials Technologies (TST5878)	507T0184	ASTM D 5147 (2014) ASTM D 6223 (2016)
PRI Construction Materials Technologies (TST5878)	507T0241	FM 4474 (D) (2011)
PRI Construction Materials Technologies (TST5878)	507T0256A	FM 4474 (C) (2011)
PRI Construction Materials Technologies (TST5878)	JMC-242-02-01	FM 4474 (D) (2011)
PRI Construction Materials Technologies (TST5878)	JMC-241-02-03	FM 4474 (C) (2011)
PRI Construction Materials Technologies (TST5878)	JMC-268-02-01	FM 4474 (D) (2011)
JMC14001.22b	FL17013-R22	



<u>Entity</u>	<u>Report No.</u>	<u>Standards (Year)</u>
PRI Construction Materials Technologies (TST5878)	507T0278	FM 4474 (C) (2011)
PRI Construction Materials Technologies (TST5878)	507T0283	FM 4474 (B) (2011)
PRI Construction Materials Technologies (TST5878)	507T0266	FM 4474 (D) (2011)
		UL 1897 (2015)
PRI Construction Materials Technologies (TST5878)	507T0267	FM 4474 (C) (2011)
PRI Construction Materials Technologies (TST5878)	507T0273	FM 4474 (C) (2011)
PRI Construction Materials Technologies (TST5878)	507T0277	FM 4474 (C) (2011)
PRI Construction Materials Technologies (TST5878)	507T0302	FM 4474 (D) (2011)
PRI Construction Materials Technologies (TST5878)	507T0303	FM 4474 (D) (2011)
PRI Construction Materials Technologies (TST5878)	507T0304	FM 4474 (B) (2011)
PRI Construction Materials Technologies (TST5878)	507T0306.1	FM 4474 (D)(2011)
PRI Construction Materials Technologies (TST5878)	507T0320	FM 4474(C) (2011)
PRI Construction Materials Technologies (TST5878)	507T0331	FM 4474(C) (2011)
PRI Construction Materials Technologies (TST5878)	507T0336	FM 4474 (B) (2011)
PRI Construction Materials Technologies (TST5878)	507T0339	FM 4474(D) (2011)
PRI Construction Materials Technologies (TST5878)	507T0342	UL 1897 (2015)
PRI Construction Materials Technologies (TST5878)	507T0343	UL 1897 (2015)
PRI Construction Materials Technologies (TST5878)	507T0344	UL 1897 (2015)
PRI Construction Materials Technologies (TST5878)	507T0381	FM 4474 (B) (2011)
PRI Construction Materials Technologies (TST5878)	507T0394	FM 4474(D) (2011)
PRI Construction Materials Technologies (TST5878)	507T0404	UL 1897 (2015)
PRI Construction Materials Technologies (TST5878)	507T0405	UL 1897 (2015)
PRI Construction Materials Technologies (TST5878)	507T0407B	UL 1897 (2015)
PRI Construction Materials Technologies (TST5878)	507T0410.1	FM 4474 (C) (2011)
Trinity ERD (TST6049)	02843.02.05-10	FM 4474 (2011)
Trinity ERD (TST6049)	10390A-10.97-1	FM 4474 (2011)
Trinity ERD (TST6049)	10390A-12.97-1	FM 4474 (2011)
Trinity ERD (TST6049)	10391.01.03	FM 4474 (2011)
Trinity ERD (TST6049)	4361-2.04.97-1	FM 4474 (2011)
Trinity ERD (TST6049)	J34190.03.11	FM 4474 (2011)
Trinity ERD (TST6049)	J5260.03.07	FM 4474 (2011)
Trinity ERD (TST6049)	JM-11190.03.16	FM 4474 (D) (2011)




LIMITATIONS

1. This report is not for use in the HVHZ.
2. Fire classification is not within the scope of this evaluation.
3. The roof deck and the roof deck attachment information are provided based on testing. FBC requirements for the rational design of the roof deck, including the attachment, are not within scope of this evaluation.
4. Foam plastic insulation shall be installed in accordance with the FBC Section 2603.4 and 2603.6.
5. Installation of the evaluated products shall comply with this report, the FBC, and the manufacturer's published application instructions. Where discrepancies exist between these sources, the more restrictive and FBC compliant installation detail shall prevail.
6. The minimum roof slope shall be 1/4:12 for new construction.
7. For assemblies containing mechanical attachment or adhered in ribbon-applied adhesive, the allowable uplift pressure for the selected assembly shall meet or exceed the minimum design loads as determined in accordance with the FBC Chapter 16. The attachment density may be increased by a qualified design professional, as necessary, to meet the design pressure requirements in the periphery zones. Calculations shall be conducted in compliance with RAS 117, RAS 137, or Section 2.2.10.1 FM LPDS 1-29 (July 2022).
8. Reroofing applications shall be examined in accordance with FBC Section 1511. For mechanically fastened systems, a field withdrawal resistance test (TAS 105 in the HVHZ; ANSI/SPRI FX-1 or TAS 105 in the non-HVHZ) shall be conducted by a qualified professional to ensure the fastener meets the minimum design load requirements of the system. For adhered systems, a field uplift resistance test (TAS 124 in the HVHZ; ASTM E 907, FM LPDS 1-52, ANSI/SPRI IA-1, or TAS 124 in the non-HVHZ) shall be conducted to confirm conformance of the existing to the minimum design loads.
9. For assemblies adhered in ribbon-applied adhesive, the allowable uplift pressure for the selected assembly shall meet or exceed the minimum design loads as determined in accordance with the FBC Chapter 16. The attachment density may be increased by a qualified design professional, as necessary, to meet the design pressure requirements in the periphery zones. Calculations shall be conducted in compliance with Section 2.2.10.1 FM LPDS 1-29 (July 2022).
10. All products listed in this report shall be manufactured under a quality assurance program in compliance with Rule 61G20-3.

COMPLIANCE STATEMENT

The products evaluated herein by Zachary R. Priest, P.E. have demonstrated compliance with the Florida Building Code, 8th Edition (2023) as evidenced in the referenced documents submitted by the named manufacturer.

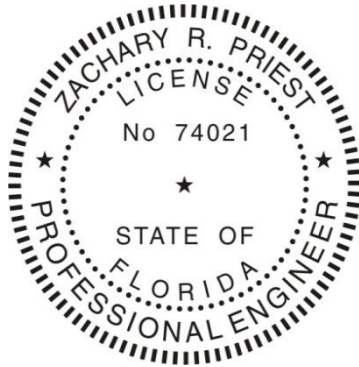

This item has been digitally signed and sealed by Zachary R. Priest, PE, on 4/3/2024.

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Zachary R. Priest, P.E.
Florida Registration No. 74021
Organization No. ANE9641

CERTIFICATION OF INDEPENDENCE

CREEK Technical Services, LLC does not have, nor will it acquire, a financial interest in any company manufacturing or distributing products under this evaluation.

CREEK Technical Services, LLC is not owned, operated, or controlled by any company manufacturing or distributing products under this evaluation.

Zachary R. Priest, P.E. does not have, nor will acquire, a financial interest in any company manufacturing or distributing products under this evaluation.

Zachary R. Priest, P.E. does not have, nor will acquire, a financial interest in any other entity involved in the approval process of the product.

APPENDICES

- 1) [APPENDIX A](#) – Installation (4 pages)
- 2) [APPENDIX B](#) – Nomenclature and Approved Assemblies (33 pages)

INSTALLATION

Note - Refer to the [APPROVED ASSEMBLIES](#) section of this report within Appendix B for specific installation details of a selected assembly.

Unless otherwise specified in this report the following installation details shall be met for the named products:


Component	Product	Installation Detail
Fastening Systems	JM All Purpose Fastener	#14 fasteners; Min. 3/4-inch penetration through the top rib of the steel deck or wood deck; Min. 1-inch penetration into concrete deck
	JM APB Plates	2-inch diameter; Galvalume steel plate with reinforcing ribs and barbs
	JM High Load Plates	2 3/8-inch diameter; Galvalume steel plate with eyehooks
	JM High Load Fastener	#15 fastener; Min. 3/4-inch penetration through the top rib of the steel deck or wood deck
	JM Lightweight Concrete (LWC) CR Base Sheet Fastener	Min. 1.7-inch shank; Pre-Assembled with 2.7-inch galvalume coated steel plate. Full embedment of shank into substrate
	JM Polymer Membrane Batten	Membrane anchors and plastic strips
	JM Structural Concrete Deck Fasteners	Hammer-in fasteners; Min. 1-inch penetration into concrete deck
	JM UltraFast Fastener #12 Hex Head	#12 fastener; Min. 3/4-inch penetration through the top rib of the steel deck or wood deck
	JM UltraFast 3" Round Metal Plate or UltraFast Plate Metal Recessed	3-inch diameter round; Galvalume steel plate
	JM UltraFast Square Metal Plate or UltraFast Plate Metal Flat	3-inch square; Galvalume steel plate
	SFS Intec Dekfast DF-#12-PH3 Fastener	#12 fasteners; Min. 3/4-inch penetration through the top rib of the steel deck or wood deck;
	SFS Intec Dekfast DF-#14-PH3 Fastener	#15 fasteners; Min. 3/4-inch penetration through the top rib of the steel deck or wood deck; Min. 1-inch penetration into concrete deck
	SFS Intec Dekfast DF-#15-PH3 Fastener	#15 fasteners; Min. 3/4-inch penetration through the top rib of the steel deck or wood deck; Min. 1-inch penetration into concrete deck
	SFS Intec Dekfast PLT-H-2-7/8	2-7/8" hexagonal galvalume steel stress plate
	SFS Intec Dekfast PLT-R-3	3-inch diameter round; Galvalume steel plate
	Trufast 3" Metal Insulation Plate	3-inch diameter round; Galvalume steel plate
	Trufast #12 DP Fastener	#12 fasteners; Min. 3/4-inch penetration through the top rib of the steel deck or wood deck;
	Trufast #14 HD Fastener	#14 fasteners; Min. 3/4-inch penetration through the top rib of the steel deck or wood deck; Min. 1-inch penetration into concrete deck
	Trufast #15 EHD Fastener	#15 fasteners; Min. 3/4-inch penetration through the top rib of the steel deck or wood deck;
	Trufast Deep Well Coiled Batten Bar	Galvalume steel membrane batten with recessed holes
OMG 3" Round Metal Plate	3-inch diameter round; Galvalume steel plate	
Trufast Twin Loc-Nail Batten Fastener	Min. 1.8" length base sheet fastener for use with Twin Loc Coiled Batten Bar	
Trufast Twin Lock Coiled Batten Bar	1" x 100' pre-punched oval coil metal batten bar	
TRUFAST VERSA-FAST Fastener	Min. 2 1/4-inch embedment into; for LWIC or Gypsum decks	
TRUFAST VERSA-FAST Metal Plate	3-inch diameter; 0.017-inch thick Galvalume steel plate with one (1) center hole and eight (8) equally spaced perimeter holes for multiple fastening	
Insulation Adhesives	ASTM D 312, Type IV Asphalt	Fully adhered within the EVT range at a rate of 20-40 lbs/100 ft ²
	JM Two Part Urethane Insulation Adhesive or JM Two-Part UIA	Ribbon adhered in 3/4 to 1-inch wide beads



Component	Product	Installation Detail
Insulation Adhesives (Cont'd)	JM Two-Part Urethane Adhesive Canister or JM Two-Part UIA Canister	Ribbon adhered in 3/4 to 1-inch wide beads
	JM One-Step Foamable Adhesive	Ribbon adhered in 3/4 to 1-inch wide beads
	JM Roofing System Urethane Adhesive	Ribbon adhered in 3/4-inch wide beads
	JM UA Canister	Ribbon adhered in 3/4 to 1-inch wide beads
Membrane Adhesives	ASTM D 312, Type IV Asphalt	Fully adhered within the EVT range at a rate of 20-40 lbs/100 ft ²
	MBR Cold Application Adhesive	Fully adhered at a rate of 1.5 to 2 gal/100 ft ²
	MBR Premium Cold Application Adhesive	
Insulation/Cover Boards	Blue Ridge Fiber Board Strucktodek® High-Density Fiber Board Roof Insulation	Min. 0.5-inch thick; Adhered boards shall be a maximum 4-ft x 4-ft
	Georgia-Pacific DensDeck	Min. 0.25-inch thick
	Georgia-Pacific DensDeck Prime	
	JM ENRGY 3 and tapered	Min. 0.5-inch thick; Min. 20 psi; Adhered boards shall be a maximum 4-ft x 4-ft
	JM ENRGY 3 C1 and tapered	
	JM ENRGY 3 AGF and tapered	
	JM ENRGY 3 CGF and tapered	
	JM ENRGY 3 C1 CGF and tapered	
	JM ENRGY 3 FR and tapered	Min. 0.5-inch thick; Min. 20 psi; Adhered boards shall be a maximum 4-ft x 4-ft
	JM DuraBoard	Min. 0.5-inch thick; Adhered boards shall be a maximum 4-ft x 4-ft
	JM Retro-Fit Board	
	JM Fesco Board	Min. 3/4-inch thick
	JM DuraFoam	Min. 1.5-inch thick; Adhered boards shall be a maximum 4-ft x 4-ft
	JM FescoFoam	
	JM ProtectoR HD	0.5-inch thick; Min. 80 psi; Adhered boards shall be a maximum 4 ft x 4 ft
	JM ProtectoR HD FR	
	JM SECUROCK Gypsum-Fiber Roof Board	Min. 0.25-inch thick
	JM SeparatoR	0.5-inch thick; Min. 25 psi; Adhered boards shall be a maximum 4 ft x 4 ft
	JM SeparatoR CGF	
	JM SeparatoR FR	
National Gypsum DEXcell FA Glass Mat Roof Board	Min. 0.25-inch thick	
USG SECUROCK Cement Board	Min. 0.5-inch thick; Adhered boards shall be a maximum 4 ft x 4 ft	
Base/Ply Sheets	JM APP Base	Min. 4-inch wide side-laps; Min. 6-inch end laps; Side-laps shall be installed perpendicular to the direction of the steel deck ribs and parallel to the direction of the wood trusses for mechanically attached systems
	APPeX 4S	
	APPeX 4S Embossed	
	Bicor S	
	Tricor S	
	DynaBase	Min. 3-inch wide side-laps; Min. 6-inch end laps; Side-laps shall be installed perpendicular to the direction of the steel deck ribs and parallel to the direction of the wood trusses for mechanically attached systems
	DynaBase PR	
	DynaFast 180 HW	
	DynaFast 180 S	
	DynaFast 250 HW	
	DynaLastic 180 S	
	DynaLastic 250 S	
	DynaWeld 250 S	
	GlasBase Plus	
	GlasPly IV	
	GlasPly Premier	
PermaPly 28		
Ventsulation Felt		



Component	Product	Installation Detail
Base/Ply Sheets (Cont'd)	DynaGrip Base SD/SA	Min. 3 5/8-inch side-laps; Self-adhered
	DynaGrip Base PR SD/SA	
Cap Sheets	APPeX 4.5 M	Min. 4-inch wide side-laps; Min. 6-inch end laps
	APPeX 4.5 M FR	
	Bicor M FR	
	Tricor M FR	
	Tricor M FR CR	
Cellular Lightweight Concrete	Celcore MF with HS Rheology Admixture	Slurry coat min. 0.25-inch thick; 1-inch thick EPS board (1 lbs/ft ³); Min. 2-inch thick top coat; Celcore PVA curing compound applied at rate of 300 ft ² /gal
	Celcore S-1	Steel deck is treated by applying a continuous film with a broom prior to placement of the Celcore lightweight concrete
	Elastizell	Slurry coat min. 1/8-inch thick; Min. 1-inch thick EPS board (1 lbs/ft ³); Min. 2-inch top coat;
	Cellular Lightweight Concrete	
Vapor Barrier	DynaBase HW	Min. 3-inch wide side-laps; Min. 6-inch end laps; Torch adhered to primed concrete deck
	JM DynaWeld Base	
	JM DynaWeld Cap	
	JM DynaBase	Min. 3-inch wide side-laps; Min. 6-inch end laps; Applied with hot or cold <i>approved</i> adhesives
	JM DynaBase PR	
	DynaFast 180 S	
	JM DynaLastic 180 S	
	JM DynaLastic 250 S	Min. 3-inch wide side-laps; Min. 6-inch end laps; Self-adhered
	JM DynaGrip Base SD/SA	
	JM DynaGrip Base PR SD/SA	
	JM Vapor Barrier SA	
JM Vapor Barrier SAR	Min. 4-inch wide side-laps; Min. 6-inch end laps; Torch adhered to primed concrete deck	
JM APP Base		
Vapor Barrier Adhesives	DynaSet 1k	Min. 4-inch side laps sealed at a rate of 1.5-2.0gal/100ft ² ; Applied to substrate in 0.5-0.75-inch wide continuous ribbons
	DynaSet 2k	

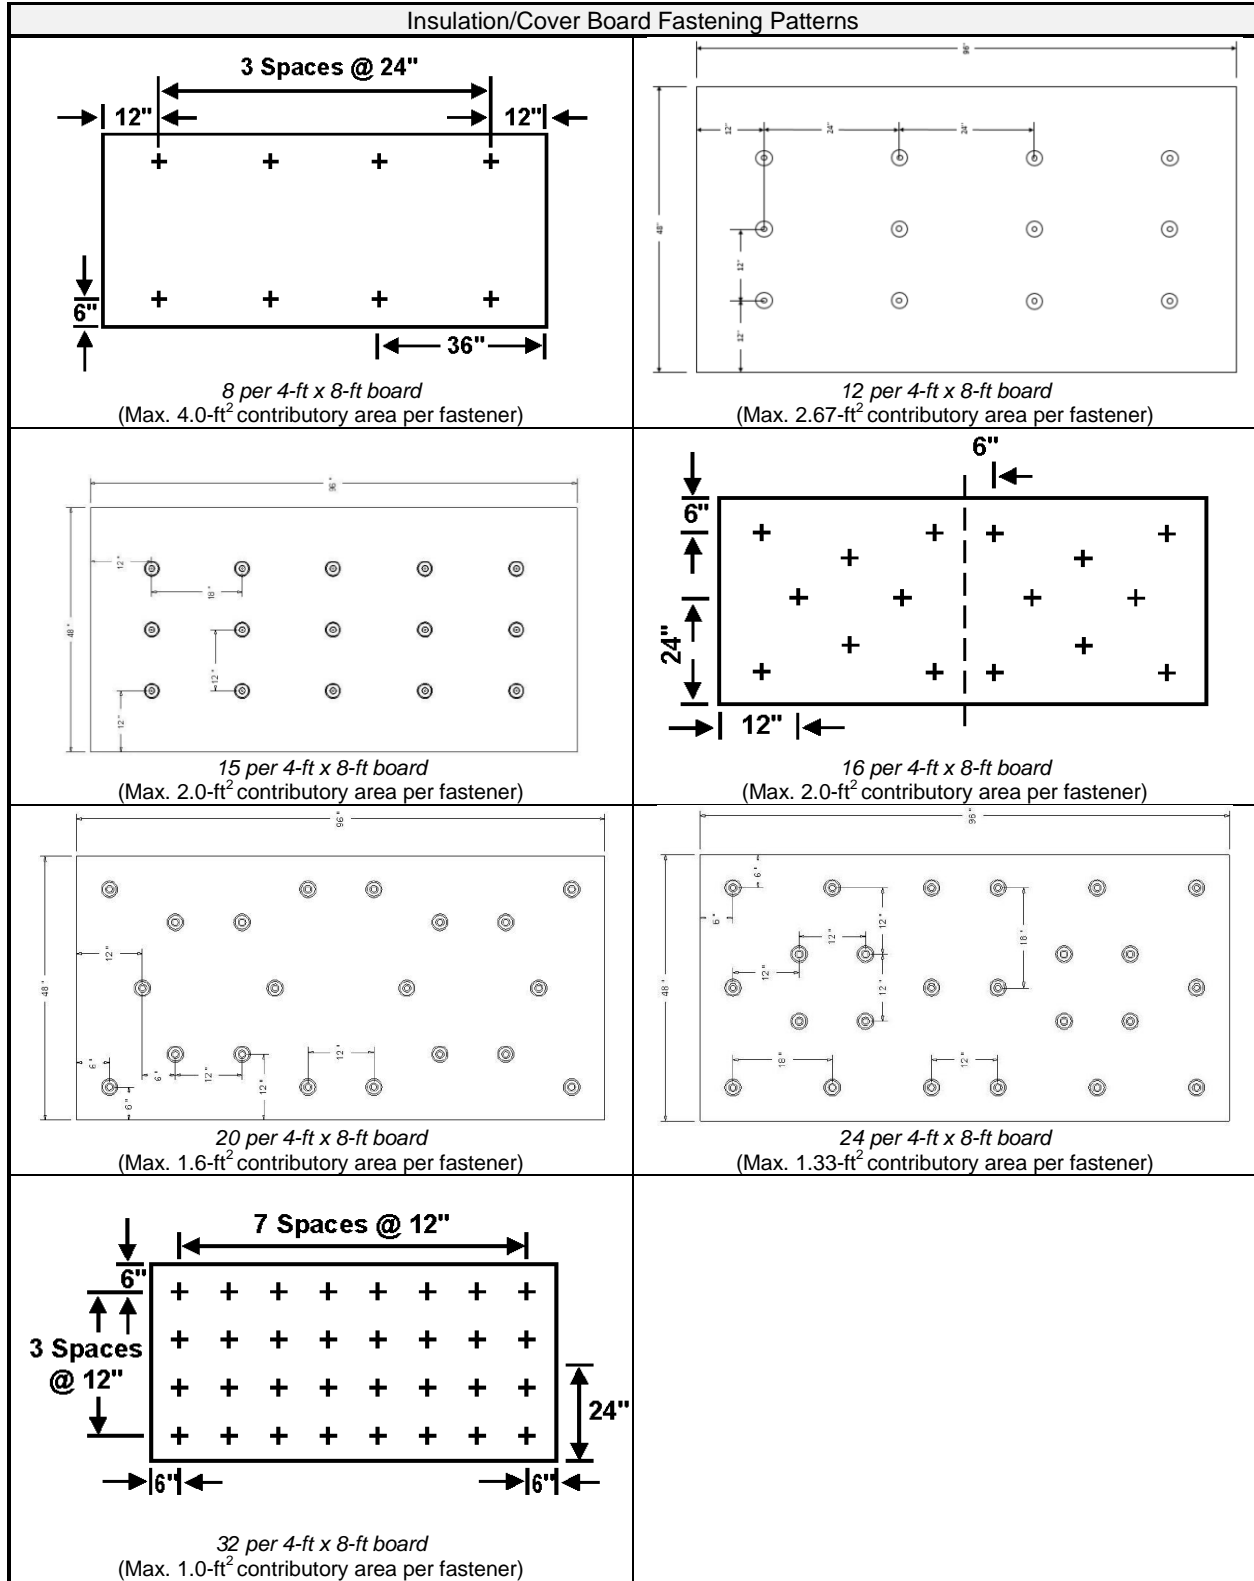

NOMENCLATURE

The following naming conventions are utilized to specify products in the [APPROVED ASSEMBLIES](#) section of this report. Refer to the nomenclature below when deciphering the allowable products for use in the selected assembly. Installation requirements shall be as noted in the [APPROVED ASSEMBLIES](#) and [INSTALLATION](#) section of this report.

Name	Definition	
2-Part UIA	JM Two-Part Urethane Insulation Adhesive, JM Two-Part UIA, JM Two-Part Urethane Adhesive Canister, or JM Two-Part UIA Canister	
AP & UF Plates	All Purpose Fasteners (<i>Concrete Deck, Steel Deck, or Wood Deck</i>), or JM High Load Fasteners (<i>Wood Deck or Steel Deck</i>) with JM UltraFast Square Metal Plate, UltraFast Plate Metal Flat, UltraFast 3" Round Metal Plate, or UltraFast Plate Metal Recessed	
AP Fasteners & Plates	All Purpose Fastener, Trufast #14 HD Fastener, or Structural Concrete Deck Fastener (concrete only) and UltraFast 3" Round Metal Plate, UltraFast Plate Metal Recessed, UltraFast Plate Metal Flat, or UltraFast Square Metal Plate	
APB Fasteners & Plates	JM APB Plates and JM High Load Fasteners or Trufast #15 EHD Fasteners	
APPeX 4S	One or more plies of APPeX 4S or APPeX 4S Embossed fully bonded by torch adhering	
Asphalt	ASTM D 312, Type IV asphalt, concrete deck shall be primed with ASTM D 41 primer prior to application	
BA APP Cap	One ply of Bicolor M FR, Tricolor M FR, or Tricolor M FR CR fully bonded in MBR Bonding Adhesive	
BA APP Ply	One or more plies of Bicolor S or Tricolor S fully bonded in MBR Bonding Adhesive	
Batten Bar	High Load LH and Polymer Membrane Batten or High Load Fastener and Trufast Deep Well Coiled Batten Bar	
CA APP Cap	One ply of Bicolor M FR, Tricolor M FR, or Tricolor M FR CR fully bonded in MBR Cold Application Adhesive	
CA APP Ply	One or more plies of JM APP Base, Bicolor S or Tricolor S fully bonded in MBR Cold Application Adhesive	
CA APP BUR	One or more plies of JM APP Base, Bicolor S, GlasBase Plus, or PermaPly 28 fully bonded in MBR Cold Application Adhesive	
Deck Detail	All decks shall be designed by others in accordance with FBC requirements.	
	Concrete Deck	Min. $f'_c = 2,500$ psi at 28 days
	Steel Deck	Min. 22 ga, Wide Rib Deck (Type WR) conforming to ANSI/SDI-RD1.0 & FBC; 0.5% Vented for LWIC applications only.
		G<#>
	Wood Deck	APA span-rated sheathing.
		T<#>O
T<#>P		Min. <#>-inch thickness of the plywood sheathing complying with PS 1-19
L<#>		Max. span of <#> inches
DensDeck Prime	Min. 0.25-inch DensDeck Prime Roof Board	
DEXcell FA	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	
DF	Dekfast DF-#12-PH3 <i>Steel Deck, or Wood Deck</i>), Dekfast DF-#14-PH# (<i>Concrete Deck, Steel Deck, or Wood Deck</i>), or Dekfast DF-#15-PH3 (<i>Steel Deck, or Wood Deck</i>) with Dekfast PLT-R-3	
DynaFast 1	One ply of DynaFast 180 HW or DynaFast 250 HW mechanically attached as prescribed per the approved assembly	
DynaFast 2	One ply of DynaFast 180 S, DynaFast 180 HW or DynaFast 250 HW mechanically attached as prescribed per the approved assembly	
E3	JM ENRGY 3 or JM ENRGY 3 CGF	
E3 C1	JM ENRGY 3 C1 or JM ENRGY 3 C1 CGF	



Name	Definition			
Fasteners & Plates	Choose one of the following fastener and plate combinations for the given conditions:			
	Board or Base Sheet	Fastener	Plate	Roof Deck
	Any	JM All Purpose Fastener, JM Structural Concrete Deck Fastener, Dekfast DF-#14-PH3, or Trufast #14 HD Fastener	JM UltraFast Square Metal Plate, UltraFast Plate Metal Flat, UltraFast 3" Round Metal Plate, or UltraFast Plate Metal Recessed	Concrete
	Any	JM UltraFast Fastener, Trufast #12 DP Fastener, Trufast #14 HD Fastener, JM High Load Fastener, Dekfast DP-#15-PH3, or Trufast #15 EHD Fastener	JM UltraFast Square Metal Plate, UltraFast Plate Metal Flat, UltraFast 3" Round Metal Plate, or UltraFast Plate Metal Recessed	Steel
	Any	JM UltraFast Fastener, Trufast #12 DP Fastener, Dekfast DF-#12-PH3, JM All Purpose Fastener, Dekfast DF-#14-PH#, JM High Load Fastener, Dekfast DF-#15-PH3, or Trufast #15 EHD Fastener	JM UltraFast Square Metal Plate, UltraFast Plate Metal Flat, UltraFast 3" Round Metal Plate, or UltraFast Plate Metal Recessed	Plywood or OSB
	Any	Dekfast DF-#14-PH3	Dekfast PLT-R-3	Concrete
	Any	Dekfast DF-#12-PH3 or Dekfast DP-#15-PH3	Dekfast PLT-R-3	Steel
	Any	Dekfast DF-#12-PH3, Dekfast DF-#14-PH#, or Dekfast DF-#15-PH3	Dekfast PLT-R-3	Plywood or OSB
	Any	JM All Purpose Fastener, JM Structural Concrete Deck Fastener, or Trufast #14 HD Fastener	Trufast 3" Metal Insulation Plates	Concrete
	ENRGY 3, SeparatoR CGF, DensDeck Prime, DEXcell FA, or SECUROCK	JM UltraFast Fastener or JM High Load Fastener	Trufast 3" Metal Insulation Plates	Steel
ENRGY 3, SeparatoR CGF, DensDeck Prime, DEXcell FA, or SECUROCK	JM UltraFast Fastener, JM All Purpose Fastener or JM High Load Fastener	Trufast 3" Metal Insulation Plates	Plywood or OSB	
Any	Trufast #12 DP Fastener, Trufast #14 HD Fastener or Trufast #15 EHD Fastener	Trufast 3" Metal Insulation Plates	Steel or OSB	
Any	Trufast #12 DP Fastener or Trufast #15 EHD Fastener	Trufast 3" Metal Insulation Plates	Plywood	
FB	One or more plies of PermaPly 28, GlasBase Plus or Ventsulation Felt preliminarily fastened below Base Sheet as a Fire Barrier			
HA BUR Base	One ply of PermaPly 28 or GlasBase Plus fully bonded in ASTM D 312, Type IV Asphalt			
HA BUR Base 2	One ply of PermaPly 28, GlasBase Plus, GlasPly Premier or GlasPly IV fully bonded in ASTM D 312, Type IV Asphalt			
HA BUR Ply	One or more plies of GlasPly IV or GlasPly Premier fully bonded in ASTM D 312, Type IV Asphalt			
HL & UF Plates	JM High Load Fasteners (<i>Wood Deck</i> or <i>Steel Deck</i>) with JM UltraFast Square Metal Plate, UltraFast Plate Metal Flat, UltraFast 3" Round Metal Plate, or UltraFast Plate Metal Recessed			



Name	Definition																														
<i>HL Fasteners & Plates</i>	JM High Load Fasteners, Trufast #15 EHD Fasteners (steel or wood deck only), or JM All Purpose Fasteners (concrete deck only) and JM High Load Plates																														
<i>Insulation</i>	One of more layers in any combination of: <table border="0" style="width: 100%;"> <tr> <td style="width: 33%;">-DensDeck</td> <td style="width: 33%;">-ENRGY 3 C1 CGF</td> <td style="width: 33%;">-RetroPlus Roof Board</td> </tr> <tr> <td>-DensDeck Prime</td> <td>-ENRGY 3 CGF</td> <td>-SECUROCK Glass-Mat Roof Board</td> </tr> <tr> <td>-DEXcell Glass Mat Roof Board</td> <td>-ENRGY 3 FR</td> <td>-SECUROCK Gypsum-Fiber Roof Board</td> </tr> <tr> <td>-DEXcell FA Glass Mat Roof Board</td> <td>-Fesco Board</td> <td>-SECUROCK Cement Roof Board</td> </tr> <tr> <td>-DEXcell Cement Board</td> <td>-FescoFoam</td> <td>-SeparatoR</td> </tr> <tr> <td>-DuraBoard</td> <td>-Invinsa Roof Board</td> <td>-SeparatoR CGF</td> </tr> <tr> <td>-DuraFoam</td> <td>-Invinsa FR Roof Board</td> <td>-SeparatoR FR</td> </tr> <tr> <td>-ENRGY 3</td> <td>-ProtectoR HD</td> <td>-EPS</td> </tr> <tr> <td>-ENRGY 3 AGF</td> <td>-ProtectoR HD FR</td> <td></td> </tr> <tr> <td>-ENRGY 3 C1</td> <td>-Retro-Fit Board</td> <td></td> </tr> </table>	-DensDeck	-ENRGY 3 C1 CGF	-RetroPlus Roof Board	-DensDeck Prime	-ENRGY 3 CGF	-SECUROCK Glass-Mat Roof Board	-DEXcell Glass Mat Roof Board	-ENRGY 3 FR	-SECUROCK Gypsum-Fiber Roof Board	-DEXcell FA Glass Mat Roof Board	-Fesco Board	-SECUROCK Cement Roof Board	-DEXcell Cement Board	-FescoFoam	-SeparatoR	-DuraBoard	-Invinsa Roof Board	-SeparatoR CGF	-DuraFoam	-Invinsa FR Roof Board	-SeparatoR FR	-ENRGY 3	-ProtectoR HD	-EPS	-ENRGY 3 AGF	-ProtectoR HD FR		-ENRGY 3 C1	-Retro-Fit Board	
-DensDeck	-ENRGY 3 C1 CGF	-RetroPlus Roof Board																													
-DensDeck Prime	-ENRGY 3 CGF	-SECUROCK Glass-Mat Roof Board																													
-DEXcell Glass Mat Roof Board	-ENRGY 3 FR	-SECUROCK Gypsum-Fiber Roof Board																													
-DEXcell FA Glass Mat Roof Board	-Fesco Board	-SECUROCK Cement Roof Board																													
-DEXcell Cement Board	-FescoFoam	-SeparatoR																													
-DuraBoard	-Invinsa Roof Board	-SeparatoR CGF																													
-DuraFoam	-Invinsa FR Roof Board	-SeparatoR FR																													
-ENRGY 3	-ProtectoR HD	-EPS																													
-ENRGY 3 AGF	-ProtectoR HD FR																														
-ENRGY 3 C1	-Retro-Fit Board																														
<i>JM UA</i>	JM UA Canister																														
<i>LWIC</i>	Poured-in-place Cellular Lightweight Concrete with encapsulated insulation board																														
<i>MBR CA</i>	MBR Cold Application Adhesive																														
<i>MBR PCA</i>	MBR Premium Cold Application Adhesive																														
<i>MA Base</i>	Two or more plies of PermaPly 28 or Ventsulation Felt mechanically attached as prescribed per the approved assembly																														
<i>MCRF</i>	Minimum Characteristic Resistance Force as determined by TAS 105 for the named fastener in the selected assembly																														
<i>MDP</i>	Maximum Design Pressure																														
<i>OSFA</i>	JM One-Step Foamable Adhesive																														
<i>Preliminarily Secured</i>	Fastened at minimum rate of four (4) fasteners per 4-ft x 8-ft board or two (2) fasteners per 4-ft x 4-ft board																														
<i>Recover</i>	Where assemblies are used to recover an existing roof, the existing roof shall consist of only one layer of roofing, i.e. recovering a previously recovered roof is not permitted. Recover roofing shall be conducted in compliance with FBC Section 1511. For mechanically fastened roof assemblies, i.e. systems x-M-#, the insulation layer is optional, or any INSULATION board or slip sheet may be used as separation layer prior to installing the approved roof assembly.																														
<i>RS Nails & Tin Tags</i>	Min. 0.120-inch x 1.25-inch ring shank roofing nails and 32ga. x 1.625-inch diameter galvanized steel tin tags																														
<i>RSUA</i>	JM Roofing System Urethane Adhesive																														
<i>SA Base</i>	One ply of DynaGrip Base SD/SA or DynaGrip Base PR SD/SA																														
<i>SECUROCK</i>	Min. 0.25-inch JM SECUROCK Gypsum-Fiber Roof Board																														
<i>Structodek HD</i>	Min. 0.5-inch Blue Ridge Fiber Board Structodek® High-Density Fiber Board Roof Insulation																														
<i>TA APP Cap</i>	One ply of APPeX 4.5 M, APPeX4.5 M FR, Bicolor M R, Tricolor M FR or Tricolor M FR CR fully bonded by torch adhering																														
<i>TA APP Ply</i>	One or more plies of JM APP Base, APPeX 4S, APPeX 4S Embossed, Bicolor S, or Tricolor S fully bonded by torch adhering																														
<i>TA SBS Ply</i>	One or more plies of DynaFast 180 HW, DynaFast 250 HW or DynaWeld 250 S fully bonded by torch adhering																														
<i>Tape & Staple</i>	0.25-inch wide SENCO tape secured with min. 16ga., 7/16-inch crown x 1-inch leg SENCO staples																														
<i>TF</i>	Trufast #12 DP Fastener (<i>Steel Deck</i> or <i>Wood Deck</i>), Trufast #14 HD Fastener (<i>Concrete Deck</i> , <i>Steel Deck</i> , or <i>Wood Deck</i>), or Trufast #15 EHD Fasteners (<i>Concrete Deck</i> , <i>Steel Deck</i> or <i>Wood Deck</i>) with Trufast 3" Metal Insulation Plate																														
<i>Tricolor</i>	One ply of Tricolor M FR or Tricolor M FR CR																														
<i>UF</i>	JM UltraFast Fasteners (<i>Steel Deck</i> or <i>Wood Deck</i>), JM All Purpose Fasteners (<i>Concrete Deck</i> , <i>Steel Deck</i> , or <i>Wood Deck</i>), or JM High Load Fasteners (<i>Wood Deck</i> or <i>Steel Deck</i>) with JM UltraFast Square Metal Plate, UltraFast Plate Metal Flat, UltraFast 3" Round Metal Plate, or UltraFast Plate Metal Recessed																														



Name	Definition																																																																																																														
<i>UF Fasteners & Plates</i>	UltraFast Fastener, Trufast #12 DP Fastener, Dekfast DP-#15-PH3, Trufast #15 EHD Fastener, or High Load Fastener with UltraFast 3" Round Metal Plate, UltraFast Plate Metal Recessed, UltraFast Plate Metal Flat or UltraFast Square Metal Plate																																																																																																														
<i>UF Fasteners & Plates (Square)</i>	UltraFast Fastener, Trufast #12 DP Fastener, Dekfast DP-#15-PH3, Trufast #15 EHD Fastener, or High Load Fastener with UltraFast Square Metal Plate or UltraFast Plate Metal Flat																																																																																																														
<i>Vapor Barriers for Adhered Assemblies over Concrete Deck</i>	One of the following options may be utilized as allowed by the <i>Approved Assembly</i> . The <i>MDP</i> shall be limited to the lesser of rating of the <i>Approved Assembly</i> and the <i>MDP</i> for the chosen vapor barrier.																																																																																																														
	<table border="1"> <thead> <tr> <th>Primer</th> <th>Vapor Barrier</th> <th>VB Application</th> <th>Insulation Adhesive</th> <th>MDP (psf)</th> </tr> </thead> <tbody> <tr> <td>None</td> <td>DynaBase HW</td> <td>Torch adhered</td> <td>OSFA 12-inch o.c.</td> <td>-172.5</td> </tr> <tr> <td>None</td> <td>DynaBase HW</td> <td>Torch adhered</td> <td>2-Part UIA 12-inch o.c.</td> <td>-135</td> </tr> <tr> <td>None</td> <td>DynaBase HW</td> <td>Torch adhered</td> <td>RSUA 12-inch o.c.</td> <td>-195</td> </tr> <tr> <td>ASTM D 41</td> <td>DynaBase HW</td> <td>Torch Adhered</td> <td>JM UA 12-inch o.c.</td> <td>-450</td> </tr> <tr> <td>ASTM D 41</td> <td>DynaGrip Base SD/SA</td> <td>Self-adhered</td> <td>OSFA 12-inch o.c.</td> <td>-90</td> </tr> <tr> <td>ASTM D 41</td> <td>DynaGrip Base SD/SA</td> <td>Self-adhered</td> <td>2-Part UIA 12-inch o.c.</td> <td>-97.5</td> </tr> <tr> <td>ASTM D 41</td> <td>DynaGrip Base SD/SA</td> <td>Self-adhered</td> <td>RSUA 12-inch o.c.</td> <td>-82.5</td> </tr> <tr> <td>ASTM D 41</td> <td>DynaGrip Base SD/SA</td> <td>Self-adhered</td> <td>JM UA 12-inch o.c.</td> <td>-97.5</td> </tr> <tr> <td>ASTM D 41</td> <td>DynaGrip Base PR SD/SA</td> <td>Self-adhered</td> <td>RSUA 12-inch o.c.</td> <td>-202.5</td> </tr> <tr> <td>ASTM D 41</td> <td>DynaGrip Base PR SD/SA</td> <td>Self-adhered</td> <td>2-Part UIA 12-inch o.c.</td> <td>-262.5</td> </tr> <tr> <td>None</td> <td>DynaLastic 180 S, DynaLastic 250 S, DynaFast 180 S, or DynaBase PR; Laps sealed with DynaSet 1k</td> <td>DynaSet 1k 12-inch o.c.</td> <td>JM UA, OSFA, 2-Part UIA, or RSUA 12-inch o.c.</td> <td>-232.5</td> </tr> <tr> <td>None</td> <td>DynaLastic 180 S, DynaLastic 250 S, DynaFast 180 S, or DynaBase PR; Laps sealed with DynaSet 1k</td> <td>DynaSet 1k 12-inch o.c.</td> <td>ASTM D 312, Type IV Asphalt</td> <td>-337.5</td> </tr> <tr> <td>None</td> <td>DynaLastic 180 S, DynaLastic 250 S, DynaFast 180 S, or DynaBase PR; Laps sealed with DynaSet 2k</td> <td>DynaSet 2k 12-inch o.c.</td> <td>JM UA, OSFA, 2-Part UIA, or RSUA 12-inch o.c.</td> <td>-97.5</td> </tr> <tr> <td>None</td> <td>DynaLastic 180 S, DynaLastic 250 S, DynaFast 180 S, or DynaBase PR; Laps sealed with DynaSet 2k</td> <td>DynaSet 2k 12-inch o.c.</td> <td>ASTM D 312, Type IV Asphalt</td> <td>-75</td> </tr> <tr> <td>ASTM D 41</td> <td>DynaWeld Base</td> <td>Torch adhered</td> <td>OSFA 12-inch o.c.</td> <td>-150</td> </tr> <tr> <td>ASTM D 41</td> <td>DynaWeld Base</td> <td>Torch adhered</td> <td>2-Part UIA 12-inch o.c.</td> <td>-120</td> </tr> <tr> <td>ASTM D 41</td> <td>DynaWeld Base</td> <td>Torch adhered</td> <td>RSUA 12-inch o.c.</td> <td>-285</td> </tr> <tr> <td>ASTM D 41</td> <td>DynaWeld Base</td> <td>Torch adhered</td> <td>JM UA 12-inch o.c.</td> <td>-345</td> </tr> <tr> <td>JM SA Primer Low VOC</td> <td>JM Vapor Barrier SA or SAR</td> <td>Self-adhered</td> <td>JM UA 12-inch o.c.</td> <td>-75</td> </tr> <tr> <td>JM SA Primer Low VOC</td> <td>JM Vapor Barrier SA or SAR</td> <td>Self-adhered</td> <td>OSFA or RSUA 12-inch o.c.</td> <td>-135</td> </tr> <tr> <td>JM SA Primer Low VOC</td> <td>JM Vapor Barrier SA or SAR</td> <td>Self-adhered</td> <td>2-Part UIA 12-inch o.c.</td> <td>-82.5</td> </tr> </tbody> </table>	Primer	Vapor Barrier	VB Application	Insulation Adhesive	MDP (psf)	None	DynaBase HW	Torch adhered	OSFA 12-inch o.c.	-172.5	None	DynaBase HW	Torch adhered	2-Part UIA 12-inch o.c.	-135	None	DynaBase HW	Torch adhered	RSUA 12-inch o.c.	-195	ASTM D 41	DynaBase HW	Torch Adhered	JM UA 12-inch o.c.	-450	ASTM D 41	DynaGrip Base SD/SA	Self-adhered	OSFA 12-inch o.c.	-90	ASTM D 41	DynaGrip Base SD/SA	Self-adhered	2-Part UIA 12-inch o.c.	-97.5	ASTM D 41	DynaGrip Base SD/SA	Self-adhered	RSUA 12-inch o.c.	-82.5	ASTM D 41	DynaGrip Base SD/SA	Self-adhered	JM UA 12-inch o.c.	-97.5	ASTM D 41	DynaGrip Base PR SD/SA	Self-adhered	RSUA 12-inch o.c.	-202.5	ASTM D 41	DynaGrip Base PR SD/SA	Self-adhered	2-Part UIA 12-inch o.c.	-262.5	None	DynaLastic 180 S, DynaLastic 250 S, DynaFast 180 S, or DynaBase PR; Laps sealed with DynaSet 1k	DynaSet 1k 12-inch o.c.	JM UA, OSFA, 2-Part UIA, or RSUA 12-inch o.c.	-232.5	None	DynaLastic 180 S, DynaLastic 250 S, DynaFast 180 S, or DynaBase PR; Laps sealed with DynaSet 1k	DynaSet 1k 12-inch o.c.	ASTM D 312, Type IV Asphalt	-337.5	None	DynaLastic 180 S, DynaLastic 250 S, DynaFast 180 S, or DynaBase PR; Laps sealed with DynaSet 2k	DynaSet 2k 12-inch o.c.	JM UA, OSFA, 2-Part UIA, or RSUA 12-inch o.c.	-97.5	None	DynaLastic 180 S, DynaLastic 250 S, DynaFast 180 S, or DynaBase PR; Laps sealed with DynaSet 2k	DynaSet 2k 12-inch o.c.	ASTM D 312, Type IV Asphalt	-75	ASTM D 41	DynaWeld Base	Torch adhered	OSFA 12-inch o.c.	-150	ASTM D 41	DynaWeld Base	Torch adhered	2-Part UIA 12-inch o.c.	-120	ASTM D 41	DynaWeld Base	Torch adhered	RSUA 12-inch o.c.	-285	ASTM D 41	DynaWeld Base	Torch adhered	JM UA 12-inch o.c.	-345	JM SA Primer Low VOC	JM Vapor Barrier SA or SAR	Self-adhered	JM UA 12-inch o.c.	-75	JM SA Primer Low VOC	JM Vapor Barrier SA or SAR	Self-adhered	OSFA or RSUA 12-inch o.c.	-135	JM SA Primer Low VOC	JM Vapor Barrier SA or SAR	Self-adhered	2-Part UIA 12-inch o.c.	-82.5
	Primer	Vapor Barrier	VB Application	Insulation Adhesive	MDP (psf)																																																																																																										
	None	DynaBase HW	Torch adhered	OSFA 12-inch o.c.	-172.5																																																																																																										
	None	DynaBase HW	Torch adhered	2-Part UIA 12-inch o.c.	-135																																																																																																										
	None	DynaBase HW	Torch adhered	RSUA 12-inch o.c.	-195																																																																																																										
	ASTM D 41	DynaBase HW	Torch Adhered	JM UA 12-inch o.c.	-450																																																																																																										
	ASTM D 41	DynaGrip Base SD/SA	Self-adhered	OSFA 12-inch o.c.	-90																																																																																																										
	ASTM D 41	DynaGrip Base SD/SA	Self-adhered	2-Part UIA 12-inch o.c.	-97.5																																																																																																										
	ASTM D 41	DynaGrip Base SD/SA	Self-adhered	RSUA 12-inch o.c.	-82.5																																																																																																										
	ASTM D 41	DynaGrip Base SD/SA	Self-adhered	JM UA 12-inch o.c.	-97.5																																																																																																										
	ASTM D 41	DynaGrip Base PR SD/SA	Self-adhered	RSUA 12-inch o.c.	-202.5																																																																																																										
	ASTM D 41	DynaGrip Base PR SD/SA	Self-adhered	2-Part UIA 12-inch o.c.	-262.5																																																																																																										
	None	DynaLastic 180 S, DynaLastic 250 S, DynaFast 180 S, or DynaBase PR; Laps sealed with DynaSet 1k	DynaSet 1k 12-inch o.c.	JM UA, OSFA, 2-Part UIA, or RSUA 12-inch o.c.	-232.5																																																																																																										
	None	DynaLastic 180 S, DynaLastic 250 S, DynaFast 180 S, or DynaBase PR; Laps sealed with DynaSet 1k	DynaSet 1k 12-inch o.c.	ASTM D 312, Type IV Asphalt	-337.5																																																																																																										
	None	DynaLastic 180 S, DynaLastic 250 S, DynaFast 180 S, or DynaBase PR; Laps sealed with DynaSet 2k	DynaSet 2k 12-inch o.c.	JM UA, OSFA, 2-Part UIA, or RSUA 12-inch o.c.	-97.5																																																																																																										
	None	DynaLastic 180 S, DynaLastic 250 S, DynaFast 180 S, or DynaBase PR; Laps sealed with DynaSet 2k	DynaSet 2k 12-inch o.c.	ASTM D 312, Type IV Asphalt	-75																																																																																																										
	ASTM D 41	DynaWeld Base	Torch adhered	OSFA 12-inch o.c.	-150																																																																																																										
	ASTM D 41	DynaWeld Base	Torch adhered	2-Part UIA 12-inch o.c.	-120																																																																																																										
	ASTM D 41	DynaWeld Base	Torch adhered	RSUA 12-inch o.c.	-285																																																																																																										
ASTM D 41	DynaWeld Base	Torch adhered	JM UA 12-inch o.c.	-345																																																																																																											
JM SA Primer Low VOC	JM Vapor Barrier SA or SAR	Self-adhered	JM UA 12-inch o.c.	-75																																																																																																											
JM SA Primer Low VOC	JM Vapor Barrier SA or SAR	Self-adhered	OSFA or RSUA 12-inch o.c.	-135																																																																																																											
JM SA Primer Low VOC	JM Vapor Barrier SA or SAR	Self-adhered	2-Part UIA 12-inch o.c.	-82.5																																																																																																											
<i>Vapor Barriers for Adhered Assemblies over CWF Deck</i>	One of the following options may be utilized as allowed by the <i>Approved Assembly</i> . The <i>MDP</i> shall be limited to the lesser of rating of the <i>Approved Assembly</i> and the <i>MDP</i> for the chosen vapor barrier.																																																																																																														
	<table border="1"> <thead> <tr> <th>Thermal Barrier</th> <th>TB Adhesive</th> <th>Primer</th> <th>Vapor Barrier</th> <th>VB Application</th> <th>Insulation Adhesive</th> <th>MDP (psf)</th> </tr> </thead> <tbody> <tr> <td>SECUROCK</td> <td>RSUA 12-inch o.c.</td> <td>ASTM D 41</td> <td>DynaWeld Cap</td> <td>Torch adhered</td> <td>RSUA 12-inch o.c.</td> <td>-250</td> </tr> </tbody> </table>	Thermal Barrier	TB Adhesive	Primer	Vapor Barrier	VB Application	Insulation Adhesive	MDP (psf)	SECUROCK	RSUA 12-inch o.c.	ASTM D 41	DynaWeld Cap	Torch adhered	RSUA 12-inch o.c.	-250																																																																																																
Thermal Barrier	TB Adhesive	Primer	Vapor Barrier	VB Application	Insulation Adhesive	MDP (psf)																																																																																																									
SECUROCK	RSUA 12-inch o.c.	ASTM D 41	DynaWeld Cap	Torch adhered	RSUA 12-inch o.c.	-250																																																																																																									



Name	Definition						
Vapor Barriers for Adhered Assemblies over Steel Deck	One of the following options may be utilized as allowed by the <i>Approved Assembly</i> . The <i>MDP</i> shall be limited to the lesser of rating of the <i>Approved Assembly</i> and the <i>MDP</i> for the chosen vapor barrier.						
	Thermal Barrier	TB Adhesive	Primer	Vapor Barrier	VB Application	Insulation Adhesive	MDP (psf)
	None	None	None	JM Vapor Barrier SA	Self-adhered	2-Part UIA, JM UA, OSFA, or RSUA 12-inch o.c.	-45
None	None	SA Primer Low VOC	JM Vapor Barrier SAR	Self-adhered	2-Part UIA, JM UA, OSFA, or RSUA 12-inch o.c.	-52.5	



APPROVED ASSEMBLIES

The following notes shall be observed when using the assembly tables below.

1. MDPs were calculated using a 2:1 margin of safety per FBC Section 1504.9.
2. Refer to [LIMITATIONS](#) and [NOMENCLATURE](#) sections of this evaluation when using the table(s) below.
3. Refer to [INSTALLATION](#) section of this report for installation detail when the information is not explicitly stated for the selected assembly.
4. The on-center (o.c.) spacing given is the maximum allowable attachment spacing for the rated system.
5. Prior to application of the approved assembly an optional vapor barrier, such as 4-6 mil polyethylene or JM Vapor Barrier SA, JM, Vapor Barrier SAR, DynaGrip Base SD/SA or DynaBase HW adhered to SECUROCK Gypsum-Fiber Roof Board, DensDeck Prime, or DEXcell FA Glass Mat Roof Board may be installed over concrete, steel, or wood decks when the approved assembly contains insulation or the membrane fastened through to the deck.
6. Base Insulation in assemblies with All Layers Adhered may be installed in one or more layers.
7. Steel deck utilized in all lightweight concrete and S-A-# systems shall be ASTM A653, G90 galvanized steel.
8. For systems C-AM-#, C-M-#, S-AM-#, and S-M-#, it is permissible to install over or substitute loose fill insulation with minimum 200psi, minimum 2-inch FBC approved lightweight insulating concrete applied over the concrete or steel deck. Fasteners shall be installed through the lightweight insulating concrete anchoring into the structural deck.

Assembly System Numbers and Definitions	
C-A-#	Assemblies with All Layers Adhered over <i>Concrete Deck</i> (New or Existing)
C-AM-#	Assemblies with Adhered Membranes over Insulated <i>Concrete Deck</i> (New, Existing, or Recover)
C-M-#	Mechanically Fastened Assemblies over <i>Concrete Deck</i> (New, Existing, or Recover)
G-A-#	Assemblies with All Layers Adhered over Poured Gypsum Deck (New or Existing)
LC-A-#	Lightweight Concrete Assemblies with All Layers Adhered over <i>Concrete Deck</i> (New or Existing)
LC-AM-#	Lightweight Concrete Assemblies with Adhered Membranes over <i>Concrete Deck</i> (New or Existing)
LC-M-#	Mechanically Fastened Lightweight Concrete Assemblies over <i>Concrete Deck</i> (New or Existing)
LS-AM-#	Lightweight Concrete Assemblies with Adhered Membranes over <i>Steel Deck</i> (New or Existing)
LS-M-#	Mechanically Fastened Lightweight Concrete Assemblies over <i>Steel Deck</i> (New or Existing)
S-A-#	Adhered <i>Steel Deck</i> Assemblies (New or Existing)
S-AM-#	Assemblies with Adhered Membranes over Insulated <i>Steel Deck</i> (New, Existing, or Recover)
S-M-#	Mechanically Fastened Assemblies over <i>Steel Deck</i> (New, Existing, or Recover)
W-A-#	Assemblies with All Layers Adhered over <i>Wood Deck</i> (New or Existing)
W-AM-#	Assemblies with Adhered Membranes over Insulated <i>Wood Deck</i> (New, Existing, or Recover)
W-M-#	Mechanically Fastened Assemblies over <i>Wood Deck</i> (New, Existing, or Recover)



Assemblies with All Layers Adhered over Concrete Deck (New or Existing)							
System No.	Vapor Barrier	Base Insulation (Note 6)	Top Insulation	Base Sheet	Ply Sheet	Cap Sheet	MDP (psf)
C-A-1	OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 1.5-inch E3, FescoFoam or DuraFoam fully adhered in Asphalt	DuraBoard fully adhered in Asphalt	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-67.5 (Lim. 9)
C-A-2	OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 1.5-inch E3 fully adhered in Asphalt	DuraBoard or FescoBoard fully adhered in Asphalt	PermaPly 28 fully bonded in Asphalt (OPTIONAL with HA BUR Ply)	OPTIONAL TA APP Ply or HA BUR Ply	TA APP Cap	-120 (Lim. 9)
C-A-3	OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 1.5-inch ENRGY 3 secured with 2-Part UIA, OSFA, or RSUA ribbons spaced 12-inch o.c.	ProtectoR HD secured with 2-Part UIA, JM UA, OSFA, or RSUA ribbons spaced 12-inch o.c.	CA APP Ply	OPTIONAL CA APP Ply	CA APP Cap	-112.5 (Lim. 9)
C-A-4	OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 1.5-inch ENRGY 3 secured with 2-Part UIA, OSFA, or RSUA ribbons spaced 12-inch o.c.	-	CA APP Ply	OPTIONAL CA APP Ply	CA APP Cap	-120 (Lim. 9)
C-A-5	OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 1-inch ENRGY 3 secured with OSFA, 2-Part UIA, or RSUA ribbons spaced 12-inch o.c.	DensDeck Prime, DEXcell FA, or SECUROCK secured with OSFA, 2-Part UIA, JM UA, or RSUA ribbons spaced 12-inch o.c.	CA APP Ply	OPTIONAL CA APP Ply	CA APP Cap	-120 (Lim. 9)
C-A-6	OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 1.5-inch ENRGY 3 secured with 2-Part UIA, OSFA, or RSUA ribbons spaced 12-inch o.c.	-	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-135 (Lim. 9)
C-A-7	OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck	Retro-Fit Board, DuraBoard, Fesco Board, or min. 1.5-inch E3, FescoFoam or DuraFoam fully adhered in Asphalt	-	PermaPly 28 fully bonded in Asphalt	OPTIONAL TA APP Ply	TA APP Cap	-150 (Lim. 9)



Assemblies with All Layers Adhered over Concrete Deck (New or Existing)							
System No.	Vapor Barrier	Base Insulation (Note 6)	Top Insulation	Base Sheet	Ply Sheet	Cap Sheet	MDP (psf)
C-A-8	OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 1.5-inch ENRGY 3 secured with 2-Part UIA, OSFA, or RSUA ribbons spaced 12-inch o.c.	ProtectoR HD secured with 2-Part UIA, OSFA, or RSUA ribbons spaced 12-inch o.c.	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-165 (Lim. 9)
C-A-9	OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 1.5-inch ENRGY 3 secured with 2-Part UIA, OSFA, or RSUA ribbons spaced 12-inch o.c.	-	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-172.5 (Lim. 9)
C-A-10	OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 1.5-inch ENRGY 3 secured with 2-Part UIA, OSFA, or RSUA ribbons spaced 12-inch o.c.	ProtectoR HD secured with 2-Part UIA, OSFA, or RSUA ribbons spaced 12-inch o.c.	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-187.5 (Lim. 9)
C-A-11	OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 1.5-inch ENRGY 3 secured with RSUA ribbons spaced 12-inch o.c.	DensDeck Prime secured with RSUA ribbons spaced 12-inch o.c.	JM APP Base torch adhered	OPTIONAL TA APP Ply	TA APP Cap	-195 (Lim. 9)
C-A-12	OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 2-inch ENRGY 3 secured in 2-Part UIA or OSFA spaced 12-inch o.c.	SECUROCK secured with 2-Part UIA or OSFA ribbons spaced 12-inch o.c.	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-232.5 (Lim. 9)
C-A-13	OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 2-inch ENRGY 3 secured in 2-Part UIA or OSFA spaced 12-inch o.c.	SECUROCK secured with 2-Part UIA or OSFA ribbons spaced 12-inch o.c.	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-232.5 (Lim. 9)
C-A-14	Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 1.5-inch ENRGY 3 secured in RSUA spaced 12-inch o.c.	SECUROCK primed with ASTM D 41 primer secured with RSUA ribbons spaced 12-inch o.c.	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-245 (Lim. 9)



Assemblies with All Layers Adhered over Concrete Deck (New or Existing)							
System No.	Vapor Barrier	Base Insulation (Note 6)	Top Insulation	Base Sheet	Ply Sheet	Cap Sheet	MDP (psf)
C-A-15	Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 1.5-inch ENRGY 3 secured in RSUA spaced 12-inch o.c.	SECUROCK primed with ASTM D 41 primer secured with RSUA ribbons spaced 12-inch o.c.	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-245 (Lim. 9)
C-A-16	Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 1.5-inch ENRGY 3 secured in RSUA spaced 12-inch o.c.	-	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-245 (Lim. 9)
C-A-17	OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 1.5-inch ENRGY 3 CGF fully adhered in Asphalt	DuraBoard fully adhered in Asphalt	PermaPly 28 fully bonded in ASTM D 312 Type IV Asphalt	OPTIONAL TA APP Ply	TA APP Cap	-277.5 (Lim. 9)
C-A-18	Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 1.5-inch ENRGY 3 CGF secured in RSUA spaced 12-inch o.c.	SECUROCK primed with ASTM D 41 primer secured with RSUA ribbons spaced 12-inch o.c.	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-292.5 (Lim. 9)
C-A-19	OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 1.5-inch ENRGY 3, ENRGY 3 AGF or FescoFoam fully adhered in Asphalt	DuraBoard fully adhered in Asphalt	PermaPly 28 fully bonded in Asphalt	OPTIONAL TA APP Ply	TA APP Cap	-305 (Lim. 9)
C-A-20	OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck	-	-	PermaPly 28 fully bonded in Asphalt	OPTIONAL TA APP Ply	TA APP Cap	-305 (Lim. 9)
C-A-21	OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck	-	-	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-315 (Lim. 9)



Assemblies with Adhered Membranes over Insulated Concrete Deck (New, Existing, or Recover)								
System No.	Base Insulation	Base Insulation Attachment	Top Insulation	Top Insulation Attachment	Base Sheet	Ply Sheet	Cap Sheet	MDP (psf)
C-AM-1	Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	ProtectoR HD	Fasteners & Plates secured at a rate of 1 per 4.0 ft ²	DynaGrip Base PR SD/SA	OPTIONAL TA APP Ply	TA APP Cap	-30 (Lim. 7)
C-AM-2	Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	ProtectoR HD	Fasteners & Plates secured at a rate of 1 per 4.0 ft ²	BA APP Ply or CA APP Ply	OPTIONAL BA APP Ply or CA APP Ply	BA APP Cap or CA APP Cap	-30 (Lim. 7)
C-AM-3	Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	Min. 0.5-inch DEXcell FA	Fasteners & Plates secured at a rate of 1 per 4.0 ft ²	CA APP Ply	OPTIONAL CA APP Ply	CA APP Cap	-37.5 (Lim. 7)
C-AM-4	Min. 1.5-inch E3, FescoFoam or DuraFoam	AP Fasteners & Plates secured at a rate of 1 fastener per 2 ft ²	Retro-Fit Board, DuraBoard, Structodek HD, or Fesco Board	Asphalt	PermaPly 28 fully bonded in Asphalt	OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 7)
C-AM-5	Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	Min. 0.5-inch DensDeck Prime	Fasteners & Plates secured at a rate of 1 fastener per 5.33ft ²	CA APP Ply or TA APP Ply	OPTIONAL CA APP Ply or TA APP Ply	CA APP Cap or TA APP Cap	-45 (Lim. 7)
C-AM-6	Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	DensDeck Prime	Fasteners & Plates secured at a rate of 1 fastener per 4ft ²	CA APP Ply or TA APP Ply	OPTIONAL CA APP Ply or TA APP Ply	CA APP Cap or TA APP Cap	-45 (Lim. 7)
C-AM-7	Min. 2-inch E3	Fasteners & Plates secured at a rate of 1 fastener per 4ft ²	ProtectoR HD	JM UA, OSFA, RSUA, or 2-Part UIA applied 12-inch o.c.	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 7)
C-AM-8	Min. 2-inch E3	Fasteners & Plates secured at a rate of 1 fastener per 4ft ²	DensDeck Prime, DEXcell FA, or SECUROCK	JM UA, OSFA, RSUA, or 2-Part UIA applied 12-inch o.c.	CA APP Ply or TA APP Ply	OPTIONAL CA APP Ply or TA APP Ply	CA APP Cap or TA APP Cap	-45 (Lim. 7)
C-AM-9	Min. 2-inch E3	Fasteners & Plates secured at a rate of 1 fastener per 4ft ²	DensDeck Prime, DEXcell FA, or SECUROCK	JM UA, OSFA, RSUA, or 2-Part UIA applied 12-inch o.c.	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 7)
C-AM-10	Min. 2-inch E3	Fasteners & Plates secured at a rate of 1 fastener per 4ft ²	Min. 1.5-inch E3	JM UA, RSUA or 2-Part UIA applied 12-inch o.c.	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 7)
C-AM-11	Min. 1.5-inch E3, FescoFoam or DuraFoam	AP Fasteners & Plates secured at a rate of 1 fastener per 1.33 ft ²	Retro-Fit Board, DuraBoard, Structodek HD, or Fesco Board	Asphalt	PermaPly 28 fully bonded in Asphalt	OPTIONAL TA APP Ply	TA APP Cap	-52.5 (Lim. 7)
C-AM-12	Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	DensDeck Prime	Fasteners & Plates secured at a rate of 16 per 4-ft x 8-ft Board	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-60 (Lim.7)
C-AM-13	Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	DensDeck Prime	Fasteners & Plates secured at a rate of 16 per 4-ft x 8-ft Board	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-60 (Lim.7)



Assemblies with Adhered Membranes over Insulated Concrete Deck (New, Existing, or Recover)								
System No.	Base Insulation	Base Insulation Attachment	Top Insulation	Top Insulation Attachment	Base Sheet	Ply Sheet	Cap Sheet	MDP (psf)
C-AM-14	OPTIONAL Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	Min. 3/4-inch DuraBoard	AP Fasteners & Plates secured at a rate of 1 per 1.33 ft ²	TA APP Ply	-	TA APP Cap	-67.5 (Lim. 7)
C-AM-15	OPTIONAL Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	Min. 3/4-inch DuraBoard	AP Fasteners & Plates secured at a rate of 1 per 1.33 ft ²	TA APP Ply	-	TA APP Cap	-75 (Lim. 7)
C-AM-16	Min. 2-inch E3	Fasteners & Plates secured at a rate of 1 per 1.45 ft ²	Min. 0.5-inch Retro-Fit Board or DuraBoard	Asphalt	3 plies HA BUR Ply	-	TA APP Cap	-75 (Lim. 7)
C-AM-17	OPTIONAL Insulation	Simultaneously fastened with Top Insulation	Min. 2-inch E3	Fasteners & Plates secured at a rate of 20 per 4-ft x 8-ft board	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-75 (Lim. 7)
C-AM-18	Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	Min. 0.5-inch DensDeck Prime	Fasteners & Plates secured at a rate of 16 per 4-ft x 8-ft Board	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-75 (Lim. 7)
C-AM-19	Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	Min. 0.5-inch DensDeck Prime	Fasteners & Plates secured at a rate of 16 per 4-ft x 8-ft Board	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-75 (Lim. 7)

Mechanically Fastened Assemblies over Concrete Deck (New, Existing, or Recover)							
System No.	Insulation		Base Sheet	Base Sheet Attachment	Ply Sheet	Cap Sheet	MDP (psf)
C-M-1	OPTIONAL Retro-Fit Board DuraBoard, Fesco Board, or Min. 1.5-inch E3, FescoFoam or DuraFoam Preliminarily Secured		MA Base	AP Fasteners & Plates spaced 9-inch o.c. in the 4-inch side laps and 12-inch o.c. in two rows staggered in field of the sheet	OPTIONAL TA APP Ply	TA APP Cap	-52.5 (Lim. 7)
C-M-2	Retro-Fit Board DuraBoard, Fesco Board, or Min. 1.5-inch E3, FescoFoam or DuraFoam Preliminarily Secured		GlasBase Plus	AP Fasteners & Plates spaced 9-inch o.c. in the 4-inch side laps and 12-inch o.c. in two rows staggered in field of the sheet	OPTIONAL TA APP Ply	TA APP Cap	-97.5 (Lim. 7)

Assemblies with All Layers Adhered over Poured Gypsum Deck (New or Existing)								
System No.	Base Insulation (Note 6)	Base Insulation Attachment	Cover Board	Cover Board Attachment	Base Ply	Ply Sheet	Cap Sheet	MDP (psf)
G-A-1	Min. 1.5-inch ENRGY 3	OSFA or RSUA applied 12-inch o.c.	DensDeck Prime, DEXcell FA, or SECUROCK	JM UA, OSFA or RSUA applied 12-inch o.c.	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 9)



Assemblies with All Layers Adhered over Poured Gypsum Deck (New or Existing)								
System No.	Base Insulation (Note 6)	Base Insulation Attachment	Cover Board	Cover Board Attachment	Base Ply	Ply Sheet	Cap Sheet	MDP (psf)
G-A-2	Min. 1.5-inch ENRGY 3	OSFA or RSUA applied 12-inch o.c.	DensDeck Prime, DEXcell FA, or SECUROCK	JM UA, OSFA or RSUA applied 12-inch o.c.	CA APP Ply	OPTIONAL CA APP Ply	CA APP Cap	-45 (Lim. 9)
G-A-3	Min. 1.5-inch ENRGY 3	OSFA or RSUA applied 12-inch o.c.	DensDeck Prime, DEXcell FA, or SECUROCK	JM UA, OSFA or RSUA applied 12-inch o.c.	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 9)
G-A-4	Min. 1-inch ENRGY 3	RSUA applied 12-inch o.c.	-	-	CA APP Ply	OPTIONAL CA APP Ply	CA APP Cap	-105 (Lim. 9)
G-A-5	Min. 1-inch ENRGY 3	RSUA applied 12-inch o.c.	-	-	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-105 (Lim. 9)
G-A-6	Min. 1-inch ENRGY 3	RSUA applied 12-inch o.c.	ProtectoR HD, DensDeck Prime, DEXcell FA, or SECUROCK s	RSUA applied 12-inch o.c.	CA APP Ply	OPTIONAL CA APP Ply	CA APP Cap	-105 (Lim. 9)
G-A-7	Min. 1-inch ENRGY 3	RSUA applied 12-inch o.c.	ProtectoR HD or SECUROCK	RSUA applied 12-inch o.c.	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-105 (Lim. 9)
G-A-8	Min. 1-inch ENRGY 3	RSUA applied 12-inch o.c.	DensDeck Prime or DEXcell FA	RSUA applied 12-inch o.c.	JM APP Base torch adhered	OPTIONAL TA APP Ply	TA APP Cap	-105 (Lim. 9)
G-A-9	Min. 1-inch ENRGY 3	RSUA applied 12-inch o.c.	SECUROCK primed with ASTM D 41 primer	RSUA applied 12-inch o.c.	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-105 (Lim. 9)



Lightweight Concrete Assemblies with All Layers Adhered over Concrete Deck (New or Existing)								
System No.	Vapor Barrier	LWIC	Base Insulation (Note 6)	Cover Board	Base Ply	Ply Sheet	Cap Sheet	MDP (psf)
LC-A-1	-	Min. 350 psi Celcore MF with HS Rheology Admixture	Min. 0.5-inch ENRGY 3 adhered in OSFA applied 12-inch o.c.	DensDeck Prime, DEXcell FA, or SECUROCK adhered in JM UA or OSFA applied 12-inch o.c.	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-90 (Lim. 9)
LC-A-2	-	Min. 400 psi Celcore MF with HS Rheology Admixture with DynaBase PR adhered in DynaSet 1k applied 12-inch o.c.	Min. 0.5-inch ENRGY 3 adhered in RSUA applied 12-inch o.c.	DensDeck Prime, DEXcell FA, or SECUROCK adhered n RSUA applied 12-inch o.c.	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-180 (Lim. 9)
LC-A-3	-	Min. 400 psi Celcore MF with HS Rheology Admixture with DynaBase PR adhered in DynaSet 1k applied 12-inch o.c.	Min. 0.5-inch ENRGY 3 adhered in RSUA applied 12-inch o.c.	SECUROCK adhered n RSUA applied 12-inch o.c.	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-180 (Lim. 9)
LC-A-4	-	Min. 350 psi Celcore MF with HS Rheology Admixture	Min. 0.5-inch ENRGY 3 adhered in RSUA applied 12-inch o.c.	DensDeck Prime, DEXcell FA, or SECUROCK adhered n RSUA applied 12-inch o.c.	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-232.5 (Lim. 9)
LC-A-5	-	Min. 350 psi Celcore MF with HS Rheology Admixture	Min. 0.5-inch ENRGY 3 adhered in RSUA applied 12-inch o.c.	SECUROCK adhered n RSUA applied 12-inch o.c.	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-232.5 (Lim. 9)

Lightweight Concrete Assemblies with Adhered Membranes over Concrete Deck (New or Existing)							
System No.	Vapor Barrier	LWIC	Base Sheet	Insulation/Cover Board	Ply Sheet	Cap Sheet	MDP (psf)
LC-AM-1	-	Min. 350 psi Celcore MF with HS Rheology Admixture	DynaBase, DynaLastic 180 S, GlasBase Plus, or Ventsulation Felt secured with min. 1.7-inch LWC CR Base Sheet Fasteners secured 7-inch o.c. at the 3-inch side laps and 7-inch o.c. in two (2) equally spaced staggered rows in the field	Min. 0.5-inch E3 or E3 C1 followed by DensDeck Prime, DEXcell FA, or SECUROCK adhered in 2-Part UIA applied 12-inch o.c.	TA APP Ply	TA APP Cap	-45 (Lim. 7)



Lightweight Concrete Assemblies with Adhered Membranes over <i>Concrete Deck</i> (New or Existing)							
System No.	Vapor Barrier	LWIC	Base Sheet	Insulation/Cover Board	Ply Sheet	Cap Sheet	MDP (psf)
LC-AM-2	-	Min. 350 psi Celcore MF with HS Rheology Admixture	DynaBase, DynaLastic 180 S, GlasBase Plus, or Ventsulation Felt secured with min. 1.7-inch LWC CR Base Sheet Fasteners secured 7-inch o.c. at the 3-inch side laps and 7-inch o.c. in two (2) equally spaced staggered rows in the field	Min. 0.5-inch E3 or E3 C1 followed by <i>DensDeck Prime</i> , <i>DEXcell FA</i> , or <i>SECUROCK</i> adhered in 2-Part UIA applied 12-inch o.c.	SA Base; with OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 7)
LC-AM-3	-	Min. 350 psi Celcore MF with HS Rheology Admixture	DynaBase, DynaLastic 180 S, GlasBase Plus, or Ventsulation Felt secured with min. 1.7-inch LWC CR Base Sheet Fasteners secured 7-inch o.c. at the 3-inch side laps and 7-inch o.c. in two (2) equally spaced staggered rows in the field	<i>DensDeck Prime</i> , <i>DEXcell FA</i> , or <i>SECUROCK</i> adhered in 2-Part UIA applied 12-inch o.c.	TA APP Ply	TA APP Cap	-45 (Lim. 7)
LC-AM-4	-	Min. 350 psi Celcore MF with HS Rheology Admixture	DynaBase, DynaLastic 180 S, GlasBase Plus, or Ventsulation Felt secured with min. 1.7-inch LWC CR Base Sheet Fasteners secured 7-inch o.c. at the 3-inch side laps and 7-inch o.c. in two (2) equally spaced staggered rows in the field	Min. 0.5-inch E3 or E3 C1 adhered 12-inch o.c. in 2-Part UIA followed by <i>DEXcell FA</i> adhered 12-inch o.c. in OSFA	Bicor S adhered in MBR PCA	<i>Tricor</i> adhered in MBR PCA	-45 (Lim. 7)
LC-AM-5	-	Min. 350 psi Celcore MF with HS Rheology Admixture	DynaBase, DynaLastic 180 S, GlasBase Plus, or Ventsulation Felt secured with min. 1.7-inch LWC CR Base Sheet Fasteners secured 7-inch o.c. at the 3-inch side laps and 7-inch o.c. in two (2) equally spaced staggered rows in the field	Min. 0.5-inch E3 or E3 C1 adhered 12-inch o.c. in 2-Part UIA followed by SeparatoR CGF adhered 12-inch o.c. in 2-Part UIA, OSFA, or RSUA	CA APP BUR	<i>Tricor</i> adhered in MBR CA	-45 (Lim. 7)



Lightweight Concrete Assemblies with Adhered Membranes over <i>Concrete Deck</i> (New or Existing)							
System No.	Vapor Barrier	LWIC	Base Sheet	Insulation/Cover Board	Ply Sheet	Cap Sheet	MDP (psf)
LC-AM-6	-	Min. 340 psi Celcore MF with HS Rheology Admixture	DynaBase PR secured with Trufast VERSA-FAST fasteners and plates (1 fastener per plate) 12-inch o.c. at the 4-inch side laps and 12-inch o.c. in two (2) equally spaced, staggered rows in the field	Min. 2-inch E3 adhered 12-inch o.c. over the fasteners rows in RSUA	SA Base; with OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 7)
LC-AM-7	-	Min. 430 psi Concrecel	-	Min. 0.5-inch DensDeck Prime secured with Trufast VERSA-Plates installed at a rate of 1 plate per 2ft ² ; Trufast VERSA-FAST fasteners installed at a rate of two (2) fasteners per plate	TA APP Ply or SA Base; with OPTIONAL TA APP Ply	TA APP Cap	-52.5 (Lim. 7)
LC-AM-8	-	Min. 340 psi Celcore MF with HS Rheology Admixture	-	Min. 2-inch E3 secured with Trufast VERSA-Plates installed at a rate of 1 plate per 2ft ² ; Trufast VERSA-FAST fasteners installed at a rate of two (2) fasteners per plate	SA Base; with OPTIONAL TA APP Ply	TA APP Cap	-60 (Lim. 7)

Mechanically Fastened Lightweight Concrete Assemblies over <i>Concrete Deck</i> (New or Existing)							
System No.	Vapor Barrier	LWIC	Base Sheet	Base Sheet Attachment	Ply Sheet	Cap Sheet	MDP (psf)
LC-M-1	-	Min. 300 psi Existing Cellular Lightweight Concrete (MCRF ≥ 83lb)	JM APP Base	1.7-inch Lightweight Concrete (LWC) CR Base Sheet Fastener installed 7-inch o.c. in 3-inch side laps and 7-inch o.c. in two (2) equally spaced, staggered rows in the field	TA SBS Ply	TA APP Cap	-37.5 (Lim. 7)
LC-M-2	-	Min. 400 psi Celcore MF with HS Rheology Admixture	JM APP Base	1.7-inch Lightweight Concrete (LWC) CR Base Sheet Fastener installed 12-inch o.c. in 4-inch side laps and 12-inch o.c. in three (3) equally spaced, staggered rows in the field	TA APP Ply	TA APP Cap	-45 (Lim. 7)
LC-M-3	-	Min. 310 psi Elastizell with Zell-Crete Fibers	JM APP Base	1.7-inch Lightweight Concrete (LWC) CR Base Sheet Fastener installed 7-inch o.c. in 3-inch side laps and 7-inch o.c. in two (2) equally spaced, staggered rows in the field	TA SBS Ply	TA APP Cap	-45 (Lim. 7)



Mechanically Fastened Lightweight Concrete Assemblies over <i>Concrete Deck</i> (New or Existing)							
System No.	Vapor Barrier	LWIC	Base Sheet	Base Sheet Attachment	Ply Sheet	Cap Sheet	MDP (psf)
LC-M-4	OPTIONAL DynaBase HW torch applied over deck primed with ASTM D 41 primer	Min. 440 psi Celcore MF with HS Rheology Admixture	<i>DynaFast 1</i>	Trufast Twin Loc-Nail Batten Fastener and Trufast Twin Lock Coiled Batten Bar spaced 6-inch o.c. within the 4-inch wide heat welded side laps	OPTIONAL <i>TA SBS Ply</i>	<i>TA APP Cap</i>	-52.5 (Lim. 7)
LC-M-5	OPTIONAL DynaBase HW torch applied over deck primed with ASTM D 41 primer	Min. 500 psi Celcore MF with HS Rheology Admixture	<i>DynaFast 1</i>	Trufast Twin Loc-Nail Batten Fastener and Trufast Twin Lock Coiled Batten Bar spaced 6-inch o.c. within the 4-inch wide heat welded side laps	OPTIONAL <i>TA SBS Ply</i>	<i>TA APP Cap</i>	-60 (Lim. 7)
LC-M-6	-	Min. 440 psi Elastizell with Zell-Crete Fibers	<i>DynaFast 1</i>	<i>HL Fasteners & Plates</i> spaced 12-inch o.c within 5-inch heat welded side laps	OPTIONAL <i>TA SBS Ply</i>	<i>TA APP Cap</i>	-60 (Lim. 7)
LC-M-7	-	Min. 430 psi <i>Existing</i> Cellular Lightweight Concrete (<i>MCRF</i> ≥ 106lbf)	JM APP Base	1.7-inch Lightweight Concrete (LWC) CR Base Sheet Fastener installed 7-inch o.c. in 4-inch side laps and 7-inch o.c. in two (2) equally spaced, staggered rows in the field	<i>TA SBS Ply</i>	<i>TA APP Cap</i>	-67.5 (Lim. 7)
LC-M-8	-	Min. 340 psi Celcore MF with HS Rheology Admixture over deck treated with Celcore S-1	JM APP Base	1.7-inch Lightweight Concrete (LWC) CR Base Sheet Fastener installed 7-inch o.c. in 3-inch side laps and 7-inch o.c. in two (2) equally spaced, staggered rows in the field	<i>TA SBS Ply</i>	<i>TA APP Cap</i>	-67.5 (Lim. 7)
LC-M-9	-	Min. 350 psi Celcore MF with HS Rheology Admixture	<i>DynaFast 1</i>	(4) 2.25" VERSA-FAST Fasteners installed in each VERSA-FAST Metal Plate; Plates spaced 10-inch o.c. within the 5-inch wide, torched adhered side laps	OPTIONAL <i>TA SBS Ply</i>	<i>TA APP Cap</i>	-67.5 (Lim. 7)
LC-M-10	-	Min. 440 psi Elastizell with Zell-Crete Fibers	JM APP Base	1.7-inch Lightweight Concrete (LWC) CR Base Sheet Fastener installed 7-inch o.c. in 4-inch side laps and 7-inch o.c. in two (2) equally spaced, staggered rows in the field	<i>TA SBS Ply</i>	<i>TA APP Cap</i>	-75 (Lim. 7)



Lightweight Concrete Assemblies with Adhered Membranes over Steel Deck (New or Existing)							
System No.	Deck Detail	LWIC	Base Sheet	Insulation/Cover Board	Ply Sheet	Cap Sheet	MDP (psf)
LS-AM-1	G33	Min. 350 psi Celcore MF with HS Rheology Admixture	DynaBase, DynaLastic 180 S, GlasBase Plus, or Ventsulation Felt secured with min. 1.7-inch LWC CR Base Sheet Fasteners secured 7-inch o.c. at the 3-inch side laps and 7-inch o.c. in two (2) equally spaced staggered rows in the field	Min. 0.5-inch E3 or E3 C1 followed by <i>DensDeck Prime</i> , <i>DEXcell FA</i> , or <i>SECUROCK</i> adhered in 2-Part UIA applied 12-inch o.c.	TA APP Ply	TA APP Cap	-45 (Lim. 7)
LS-AM-2	G33	Min. 350 psi Celcore MF with HS Rheology Admixture	DynaBase, DynaLastic 180 S, GlasBase Plus, or Ventsulation Felt secured with min. 1.7-inch LWC CR Base Sheet Fasteners secured 7-inch o.c. at the 3-inch side laps and 7-inch o.c. in two (2) equally spaced staggered rows in the field	Min. 0.5-inch E3 or E3 C1 followed by <i>SECUROCK</i> adhered in 2-Part UIA applied 12-inch o.c.	SA Base; with OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 7)
LS-AM-3	G33	Min. 350 psi Celcore MF with HS Rheology Admixture	DynaBase, DynaLastic 180 S, GlasBase Plus, or Ventsulation Felt secured with min. 1.7-inch LWC CR Base Sheet Fasteners secured 7-inch o.c. at the 3-inch side laps and 7-inch o.c. in two (2) equally spaced staggered rows in the field	<i>DensDeck Prime</i> , <i>DEXcell FA</i> , or <i>SECUROCK</i> adhered in 2-Part UIA applied 12-inch o.c.	TA APP Ply	TA APP Cap	-45 (Lim. 7)
LS-AM-4	G33	Min. 350 psi Celcore MF with HS Rheology Admixture	DynaBase, DynaLastic 180 S, GlasBase Plus, or Ventsulation Felt secured with min. 1.7-inch LWC CR Base Sheet Fasteners secured 7-inch o.c. at the 3-inch side laps and 7-inch o.c. in two (2) equally spaced staggered rows in the field	<i>SECUROCK</i> adhered in 2-Part UIA applied 12-inch o.c.	SA Base; with OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 7)



Lightweight Concrete Assemblies with Adhered Membranes over Steel Deck (New or Existing)							
System No.	Deck Detail	LWIC	Base Sheet	Insulation/Cover Board	Ply Sheet	Cap Sheet	MDP (psf)
LS-AM-5	G33	Min. 350 psi Celcore MF with HS Rheology Admixture	DynaBase, DynaLastic 180 S, GlasBase Plus, or Ventsulation Felt secured with min. 1.7-inch LWC CR Base Sheet Fasteners secured 7-inch o.c. at the 3-inch side laps and 7-inch o.c. in two (2) equally spaced staggered rows in the field	Min. 0.5-inch E3 or E3 C1 adhered 12-inch o.c. in 2-Part UIA followed by DEXcell FA adhered 12-inch o.c. in OSFA	Bicor S adhered in MBR PCA	Tricor adhered in MBR PCA	-45 (Lim. 7)
LS-AM-6	G33	Min. 350 psi Celcore MF with HS Rheology Admixture	DynaBase, DynaLastic 180 S, GlasBase Plus, or Ventsulation Felt secured with min. 1.7-inch LWC CR Base Sheet Fasteners secured 7-inch o.c. at the 3-inch side laps and 7-inch o.c. in two (2) equally spaced staggered rows in the field	Min. 0.5-inch E3 or E3 C1 adhered 12-inch o.c. in 2-Part UIA followed by SeparatoR CGF adhered 12-inch o.c. in 2-Part UIA, OSFA, or RSUA	CA APP BUR	Tricor adhered in MBR CA	-45 (Lim. 7)
LS-AM-7	G33	Min. 340 psi Celcore MF with HS Rheology Admixture over deck treated with Celcore S-1	DynaBase PR secured with Trufast VERSA-FAST fasteners and plates (1 fastener per plate) 12-inch o.c. at the 4-inch side laps and 12-inch o.c. in two (2) equally spaced, staggered rows in the field	Min. 2-inch E3 adhered 12-inch o.c. over the fasteners rows in RSUA	SA Base; with OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 7)
LS-AM-8	G33	Min. 430 psi Concrecel	-	Min. 0.5-inch DensDeck Prime secured with Trufast VERSA-Plates installed at a rate of 1 plate per 2ft ² ; Trufast VERSA-FAST fasteners installed at a rate of two (2) fasteners per plate	TA APP Ply or SA Base; with OPTIONAL TA APP Ply	TA APP Cap	-52.5 (Lim. 7)
LS-AM-9	G33	Min. 340 psi Celcore MF with HS Rheology Admixture over deck treated with Celcore S-1	-	Min. 2-inch E3 secured with Trufast VERSA-Plates installed at a rate of 1 plate per 2ft ² ; Trufast VERSA-FAST fasteners installed at a rate of two (2) fasteners per plate	SA Base; with OPTIONAL TA APP Ply	TA APP Cap	-60 (Lim. 7)



Mechanically Fastened Lightweight Concrete Assemblies over Steel Deck (New or Existing)							
System No.	Deck Detail	LWIC	Base Sheet	Base Sheet Attachment	Ply Sheet	Cap Sheet	MDP (psf)
LS-M-1	G33	Min. 300 psi Existing Cellular Lightweight Concrete (MCRF ≥ 83lbf)	JM APP Base	1.7-inch Lightweight Concrete (LWC) CR Base Sheet Fastener installed 7-inch o.c. in 3-inch side laps and 7-inch o.c. in two (2) equally spaced, staggered rows in the field	TA SBS Ply	TA APP Cap	-37.5 (Lim. 7)
LS-M-2	G33	Min. 400 psi Celcore MF with HS Rheology Admixture over deck treated with Celcore S-1	JM APP Base	1.7-inch Lightweight Concrete (LWC) CR Base Sheet Fastener installed 12-inch o.c. in 4-inch side laps and 12-inch o.c. in three (3) equally spaced, staggered rows in the field	TA APP Ply	TA APP Cap	-45 (Lim. 7)
LS-M-3	G33	Min. 310 psi Elastizell with Zell-Crete Fibers	JM APP Base	1.7-inch Lightweight Concrete (LWC) CR Base Sheet Fastener installed 7-inch o.c. in 3-inch side laps and 7-inch o.c. in two (2) equally spaced, staggered rows in the field	TA SBS Ply	TA APP Cap	-45 (Lim. 7)
LS-M-4	G33	Min. 440 psi Celcore MF with HS Rheology Admixture over deck treated with Celcore S-1	DynaFast 1	Trufast Twin Loc-Nail Batten Fastener and Trufast Twin Lock Coiled Batten Bar spaced 6-inch o.c. within the 4-inch wide heat welded side laps	OPTIONAL TA SBS Ply	TA APP Cap	-52.5 (Lim. 7)
LS-M-5	G33	Min. 500 psi Celcore MF with HS Rheology Admixture over deck treated with Celcore S-1	DynaFast 1	Trufast Twin Loc-Nail Batten Fastener and Trufast Twin Lock Coiled Batten Bar spaced 6-inch o.c. within the 4-inch wide heat welded side laps	OPTIONAL TA SBS Ply	TA APP Cap	-60 (Lim. 7)
LS-M-6	G33	Min. 440 psi Elastizell with Zell-Crete Fibers	DynaFast 1	HL Fasteners & Plates spaced 12-inch o.c within 5-inch heat welded side laps	OPTIONAL TA SBS Ply	TA APP Cap	-60 (Lim. 7)
LS-M-7	G33	Min. 430 psi Existing Cellular Lightweight Concrete (MCRF ≥ 106lbf)	JM APP Base	1.7-inch Lightweight Concrete (LWC) CR Base Sheet Fastener installed 7-inch o.c. in 4-inch side laps and 7-inch o.c. in two (2) equally spaced, staggered rows in the field	TA SBS Ply	TA APP Cap	-67.5 (Lim. 7)
LS-M-8	G33	Min. 340 psi Celcore MF with HS Rheology Admixture over deck treated with Celcore S-1	JM APP Base	1.7-inch Lightweight Concrete (LWC) CR Base Sheet Fastener installed 7-inch o.c. in 3-inch side laps and 7-inch o.c. in two (2) equally spaced, staggered rows in the field	TA SBS Ply	TA APP Cap	-67.5 (Lim. 7)
LS-M-9	G33	Min. 350 psi Celcore MF with HS Rheology Admixture over deck treated with Celcore S-1	DynaFast 1	(4) 2.25" VERSA-FAST Fasteners installed in each VERSA-FAST Metal Plate; Plates spaced 10-inch o.c. within the 5-inch wide, torched adhered side laps	OPTIONAL TA SBS Ply	TA APP Cap	-67.5 (Lim. 7)



Mechanically Fastened Lightweight Concrete Assemblies over Steel Deck (New or Existing)							
System No.	Deck Detail	LWIC	Base Sheet	Base Sheet Attachment	Ply Sheet	Cap Sheet	MDP (psf)
LS-M-10	G33	Min. 440 psi Elastizell with Zell-Crete Fibers	JM APP Base	1.7-inch Lightweight Concrete (LWC) CR Base Sheet Fastener installed 7-inch o.c. in 4-inch side laps and 7-inch o.c. in two (2) equally spaced, staggered rows in the field	TA SBS Ply	TA APP Cap	-75 (Lim. 7)

Adhered Steel Deck Assemblies (New and Existing)								
System No.	Deck Detail	Thermal Barrier/Vapor Barrier	Base Insulation (Note 6)	Top Insulation	Base Ply	Ply Sheet	Cap Sheet	MDP (psf)
S-A-1	G33	OPTIONAL Vapor Barriers for Adhered Assemblies over Steel Deck	Min. 1.5-inch E3 applied in 2-Part UIA, JM UA, or RSUA spaced 12-inch o.c. followed by OPTIONAL Min. 1-inch E3 applied in 2-Part UIA, JM UA, or RSUA spaced 12-inch o.c.	Min. 1-inch E3 applied in 2-Part UIA, JM UA, or RSUA spaced 12-inch o.c.	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 9)
S-A-2	G33	OPTIONAL Vapor Barriers for Adhered Assemblies over Steel Deck	Min. 1.5-inch E3 applied in 2-Part UIA, JM UA, or RSUA spaced 12-inch o.c. followed by OPTIONAL Min. 1-inch E3 applied in 2-Part UIA, JM UA, or RSUA spaced 12-inch o.c.	DensDeck Prime applied in 2-Part UIA, JM UA, OSFA, or RSUA spaced 12" o.c.	CA APP Ply or TA APP Ply	OPTIONAL CA APP Ply or TA APP Ply	CA APP Cap or TA APP Cap	-45 (Lim. 9)
S-A-3	G33	OPTIONAL Vapor Barriers for Adhered Assemblies over Steel Deck	Min. 1.5-inch E3 applied in 2-Part UIA, JM UA, or RSUA spaced 12-inch o.c. followed by OPTIONAL Min. 1-inch E3 applied in 2-Part UIA, JM UA, or RSUA spaced 12-inch o.c.	DensDeck Prime applied in 2-Part UIA, JM UA, OSFA, or RSUA spaced 12" o.c.	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 9)
S-A-4	G33	OPTIONAL Vapor Barriers for Adhered Assemblies over Steel Deck	Min. 1.5-inch E3 applied in 2-Part UIA, JM UA, or RSUA spaced 12-inch o.c. followed by OPTIONAL Min. 1-inch E3 applied in 2-Part UIA, JM UA, or RSUA spaced 12-inch o.c.	DEXcell FA, or SECUROCK secured with 2-Part UIA, JM UA, OSFA, or RSUA spaced 12" o.c.	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 9)



Adhered Steel Deck Assemblies (New and Existing)								
System No.	Deck Detail	Thermal Barrier/ Vapor Barrier	Base Insulation (Note 6)	Top Insulation	Base Ply	Ply Sheet	Cap Sheet	MDP (psf)
S-A-5	G33	OPTIONAL Vapor Barriers for Adhered Assemblies over Steel Deck	Min. 1.5-inch E3 applied in 2-Part UIA, JM UA, or RSUA spaced 12-inch o.c. followed by OPTIONAL Min. 1-inch E3 applied in 2-Part UIA, JM UA, or RSUA spaced 12-inch o.c.	ProtectoR HD, DEXcell FA, or SECUROCK secured with 2-Part UIA, JM UA, OSFA, or RSUA spaced 12" o.c.	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 9)
S-A-6	G33	OPTIONAL Vapor Barriers for Adhered Assemblies over Steel Deck	Min. 1.5-inch E3 applied in 2-Part UIA, JM UA, or RSUA spaced 12-inch o.c. followed by OPTIONAL Min. 1-inch E3 applied in 2-Part UIA, JM UA, or RSUA spaced 12-inch o.c.	ProtectoR HD or DEXcell FA secured with 2-Part UIA, JM UA, OSFA, or RSUA spaced 12" o.c.	CA APP Ply	OPTIONAL CA APP Ply	CA APP Cap	-45 (Lim. 9)
S-A-7	G33	Min. 0.5-inch DensDeck Prime secured with DF or TF at 1 fastener per 4ft ² over OPTIONAL Vapor Barrier	Min. 1.5-inch ENRGY 3 applied in 2-Part UIA, JM UA, OSFA, or RSUA applied 12" o.c.	DEXcell FA, SECUROCK, or DensDeck Prime applied in 2-Part UIA, JM UA, OSFA, or RSUA applied 12" o.c.	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 7)
S-A-8	G33	Min. 0.5-inch DensDeck Prime secured with DF or TF at 1 fastener per 4ft ² over OPTIONAL Vapor Barrier	Min. 1.5-inch ENRGY 3 applied in 2-Part UIA, JM UA, OSFA, or RSUA applied 12" o.c.	OPTIONAL ProtectoR HD, DEXcell FA, SECUROCK, or DensDeck Prime applied in 2-Part UIA, JM UA, OSFA, or RSUA applied 12" o.c.	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 7)
S-A-9	G33	Min. 0.5-inch DensDeck Prime secured with DF or TF at 1 fastener per 4ft ² over OPTIONAL Vapor Barrier	Min. 1.5-inch ENRGY 3 applied in 2-Part UIA, JM UA, OSFA, or RSUA applied 12" o.c.	OPTIONAL ProtectoR HD, DEXcell FA, or DensDeck Prime applied in 2-Part UIA, JM UA, OSFA, or RSUA applied 12" o.c.	CA APP Ply	OPTIONAL CA APP Ply	CA APP Cap	-45 (Lim. 7)
S-A-10	G33	0.5-inch DEXcell FA secured with Fasteners & Plates at a rate of 1 fastener per 4ft ² ; DynaBase HW torch applied	Min. 1.5-inch E3 applied in JM UA, RSUA or 2-Part UIA ribbons spaced 12-inch o.c.	ProtectoR HD applied in JM UA, RSUA or 2-Part UIA ribbons spaced 12-inch o.c.	BA APP Ply or CA APP Ply	OPTIONAL BA APP Ply or CA APP Ply	BA APP Cap or CA APP Cap	-45 (Lim. 7)



Adhered Steel Deck Assemblies (New and Existing)								
System No.	Deck Detail	Thermal Barrier/ Vapor Barrier	Base Insulation (Note 6)	Top Insulation	Base Ply	Ply Sheet	Cap Sheet	MDP (psf)
S-A-11	G33	Min. 0.5-inch DEXcell FA secured with Fasteners & Plates secured at a rate of 16 per 4-ft x 8-ft board; DynaWeld Base torch applied	Min. 1.5-inch ENRGY 3 applied in JM UA, OSFA, 2-Part UIA or RSUA ribbons spaced 12-inch o.c.	DensDeck Prime, DEXcell FA or SECUROCK applied in JM UA, OSFA, 2-Part UIA or RSUA spaced 12-inch o.c.	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 7)
S-A-12	G33	Min. 0.5-inch DEXcell FA secured with Fasteners & Plates secured at a rate of 16 per 4-ft x 8-ft board; DynaWeld Base torch applied	Min. 1.5-inch ENRGY 3 applied in JM UA, OSFA, 2-Part UIA or RSUA ribbons spaced 12-inch o.c.	DensDeck Prime, DEXcell FA or SECUROCK applied in JM UA, OSFA, 2-Part UIA or RSUA spaced 12-inch o.c.	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 7)
S-A-13	G33	OPTIONAL Vapor Barriers for Adhered Assemblies over Steel Deck	Min. 1.5-inch ENRGY 3 applied in JM UA or RSUA ribbons spaced 6-inch o.c.	-	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-75 (Lim. 9)
S-A-14	G33	OPTIONAL Vapor Barriers for Adhered Assemblies over Steel Deck	Min. 1.5-inch ENRGY 3 applied in JM UA or RSUA ribbons spaced 6-inch o.c.	SECUROCK applied in JM UA, OSFA, RSUA or 2-Part UIA spaced 6-inch o.c.	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-75 (Lim. 9)
S-A-15	G33	OPTIONAL Vapor Barriers for Adhered Assemblies over Steel Deck	Min. 1.5-inch ENRGY 3 applied in JM UA or RSUA ribbons spaced 6-inch o.c.	DensDeck Prime, DEXcell FA, or SECUROCK applied in JM UA, OSFA, RSUA or 2-Part UIA ribbons spaced 6-inch o.c.	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-75 (Lim. 9)
S-A-16	G33	OPTIONAL Vapor Barriers for Adhered Assemblies over Steel Deck	Min. 1.5-inch ENRGY 3 applied in JM UA or RSUA ribbons spaced 6-inch o.c.	DensDeck Prime or DEXcell FA applied in JM UA, OSFA, RSUA or 2-Part UIA ribbons spaced 6-inch o.c.	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-82.5 (Lim. 9)



Assemblies with Adhered Membranes over Insulated Steel Deck (New, Existing, or Recover)									
System No.	Deck Detail	Base Insulation	Base Insulation Attachment	Top Insulation	Top Insulation Attachment	Base Ply	Ply Sheet	Cap Sheet	MDP (psf)
S-AM-1	G33	Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	ProtectoR HD	Fasteners & Plates secured at a rate of 1 per 4.0 ft ²	DynaGrip Base PR SD/SA	OPTIONAL TA APP Ply	TA APP Cap	-30 (Lim. 7)
S-AM-2	G33	Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	ProtectoR HD	Fasteners & Plates secured at a rate of 1 per 4.0 ft ²	BA APP Ply or CA APP Ply	OPTIONAL BA APP Ply or CA APP Ply	BA APP Cap or CA APP Cap	-30 (Lim. 7)
S-AM-3	G33	Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	Min. 0.5-inch DEXcell FA	Fasteners & Plates secured at a rate of 1 per 4.0 ft ²	CA APP Ply	OPTIONAL CA APP Ply	CA APP Cap	-37.5 (Lim. 7)
S-AM-4	G33	Min. 1.5-inch E3	UF Fasteners & Plates secured at a rate of 1 per 4.0 ft ²	Min. 0.5-inch SECUROCK	JM UA, RSUA, or 2-Part UIA spaced 12-inch o.c.	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 7)
S-AM-5	G33	Min. 2-inch E3	UF Fasteners & Plates secured at a rate of 1 per 5.33 ft ²	Min. 0.5-inch SECUROCK	JM UA, RSUA, or 2-Part UIA spaced 12-inch o.c.	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 7)
S-AM-6	G33	OPTIONAL Insulation under Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	Min. 0.5-inch DensDeck Prime	UltraFast Square Metal Plate and High Load fasteners secured at a rate of 1 fastener per 5.33ft ²	JM APP Base torch adhered or CA APP Ply	OPTIONAL TA APP Ply or CA APP Ply	CA APP Cap or TA APP Cap	-45 (Lim. 7)
S-AM-7	G33	OPTIONAL Insulation under Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	DensDeck Prime	Fasteners & Plates secured at a rate of 1 fastener per 4ft ²	JM APP Base torch adhered or CA APP Ply	OPTIONAL TA APP Ply or CA APP Ply	CA APP Cap or TA APP Cap	-45 (Lim. 7)
S-AM-8	G33	Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	Min. 0.5-inch DensDeck Prime	Fasteners & Plates secured at a rate of 1 fastener per 5.33ft ²	CA APP Ply or TA APP Ply	OPTIONAL CA APP Ply or TA APP Ply	CA APP Cap or TA APP Cap	-45 (Lim. 7)
S-AM-9	G33	Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	DensDeck Prime	Fasteners & Plates secured at a rate of 1 fastener per 4ft ²	CA APP Ply or TA APP Ply	OPTIONAL CA APP Ply or TA APP Ply	CA APP Cap or TA APP Cap	-45 (Lim. 7)
S-AM-10	G33	Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	Min. 0.5-inch SECUROCK Cement Board; primed with ASTM D 41 primer	Fasteners & Plates secured at a rate of 1 fastener per 4ft ²	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 7)



Assemblies with Adhered Membranes over Insulated Steel Deck (New, Existing, or Recover)									
System No.	Deck Detail	Base Insulation	Base Insulation Attachment	Top Insulation	Top Insulation Attachment	Base Ply	Ply Sheet	Cap Sheet	MDP (psf)
S-AM-11	G33	Min. 0.5-inch SECUROCK Cement Board primed with ASTM D 41 primer followed by Tricor M FR torch adhered after board is fastened	Fasteners & Plates secured at a rate of 1 fastener per 4ft ²	Min. 1.5-inch ENRGY 3 followed by Min. 0.5-inch SECUROCK Cement Board primed with ASTM D 41 primer	ENRGY 3 and SECUROCK Cement Board adhered in JM UA or RSUA applied 12-inch o.c.	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 7)
S-AM-12	G33	OPTIONAL Insulation	Simultaneously fastened with Top Insulation	Min. 2-inch ENRGY 3	Fasteners & Plates at a rate of 1 fastener per 4ft ²	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 7)
S-AM-13	G33	OPTIONAL Insulation	Simultaneously fastened with Top Insulation	Min. 2-inch ENRGY 3	Fasteners & Plates at a rate of 1 fastener per 4ft ²	CA APP Ply	OPTIONAL CA APP Ply	CA APP Cap	-45 (Lim. 7)
S-AM-14	G33	Min. 2-inch E3	Fasteners & Plates secured at a rate of 1 fastener per 4ft ²	ProtectoR HD	JM UA, OSFA, RSUA, or 2-Part UIA applied 12-inch o.c.	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 7)
S-AM-15	G33	Min. 2-inch E3	Fasteners & Plates secured at a rate of 1 fastener per 4ft ²	Min. 0.5-inch SECUROCK Cement Board primed with ASTM D 41 primer	JM UA or RSUA applied 12-inch o.c.	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 7)
S-AM-16	G33	Min. 2-inch E3	Fasteners & Plates secured at a rate of 1 fastener per 4ft ²	DensDeck Prime, DEXcell FA, or SECUROCK	JM UA, OSFA, RSUA, or 2-Part UIA applied 12-inch o.c.	CA APP Ply or TA APP Ply	OPTIONAL CA APP Ply or TA APP Ply	CA APP Cap or TA APP Cap	-45 (Lim. 7)
S-AM-17	G33	Min. 2-inch E3	Fasteners & Plates secured at a rate of 1 fastener per 4ft ²	DensDeck Prime, DEXcell FA, or SECUROCK	JM UA, OSFA, RSUA, or 2-Part UIA applied 12-inch o.c.	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 7)
S-AM-18	G33	Min. 2-inch E3	Fasteners & Plates secured at a rate of 1 fastener per 4ft ²	Min. 1-inch E3	JM UA, RSUA or 2-Part UIA applied 12-inch o.c.	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 7)
S-AM-19	G33	Min. 1.5-inch E3	Fasteners & Plates secured 1 fastener per 2.67ft ²	Min. 1-inch E3	JM UA, 2-Part UIA or RSUA applied 12" o.c.	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 7)



Assemblies with Adhered Membranes over Insulated Steel Deck (New, Existing, or Recover)									
System No.	Deck Detail	Base Insulation	Base Insulation Attachment	Top Insulation	Top Insulation Attachment	Base Ply	Ply Sheet	Cap Sheet	MDP (psf)
S-AM-20	G33	Min. 1.5-inch E3	Fasteners & Plates secured 1 fastener per 2.67ft ²	ProtectoR HD	JM UA, OSFA, RSUA, or 2-Part UIA applied 12-inch o.c.	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 7)
S-AM-21	G33	Min. 1.5-inch E3	Fasteners & Plates secured 1 fastener per 2.67ft ²	Min. 0.5-inch SECUROCK Cement Board primed with ASTM D 41 primer	JM UA or RSUA applied 12-inch o.c.	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 7)
S-AM-22	G33	Min. 1.5-inch E3	Fasteners & Plates secured 1 fastener per 2.67ft ²	DensDeck Prime, DEXcell FA, or SECUROCK	JM UA, OSFA, RSUA, or 2-Part UIA applied 12-inch o.c.	CA APP Ply or TA APP Ply	OPTIONAL CA APP Ply or TA APP Ply	CA APP Cap or TA APP Cap	-45 (Lim. 7)
S-AM-23	G33	Min. 1.5-inch E3	Fasteners & Plates secured 1 fastener per 2.67ft ²	DensDeck Prime, DEXcell FA, or SECUROCK	JM UA, OSFA, RSUA, or 2-Part UIA applied 12-inch o.c.	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 7)
S-AM-24	G33	Min. 1.5-inch E3	Fasteners & Plates secured at a rate of 1 per 1.78 ft ²	Min. 0.5-inch SECUROCK	2-Part UIA spaced 12-inch o.c.	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-60 (Lim. 7)
S-AM-25	G33	OPTIONAL Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	SECUROCK	UF Fasteners & Plates secured at a rate of 1 per 1.78 ft ²	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-60 (Lim. 7)
S-AM-26	G33	OPTIONAL Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	SECUROCK	UF Fasteners & Plates secured at a rate of 1 per 1.78 ft ²	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-60 (Lim. 7)
S-AM-27	G33	OPTIONAL Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	DensDeck Prime or DEXcell FA	Fasteners & Plates secured at a rate of 1 per 1.78 ft ²	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-60 (Lim. 7)
S-AM-28	G33	OPTIONAL Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	DensDeck Prime or DEXcell FA	Fasteners & Plates secured at a rate of 1 per 1.78 ft ²	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-60 (Lim. 7)
S-AM-29	G33	OPTIONAL Insulation	Simultaneously fastened with Top Insulation	Min 1.5-inch E3	Fasteners & Plates secured at a rate of 1 fastener per 1.78ft ²	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-60 (Lim. 7)
S-AM-30	G33	Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	DensDeck Prime	Fasteners & Plates secured at a rate of 16 per 4-ft x 8-ft Board	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-60 (Lim.7)
S-AM-31	G33	Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	DensDeck Prime	Fasteners & Plates secured at a rate of 16 per 4-ft x 8-ft Board	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-60 (Lim.7)



Assemblies with Adhered Membranes over Insulated Steel Deck (New, Existing, or Recover)									
System No.	Deck Detail	Base Insulation	Base Insulation Attachment	Top Insulation	Top Insulation Attachment	Base Ply	Ply Sheet	Cap Sheet	MDP (psf)
S-AM-32	G33	OPTIONAL Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	Min. 3/4-inch DuraBoard	UF Fasteners & Plates secured at a rate of 1 per 1.33 ft ²	TA APP Ply	-	TA APP Cap	-67.5 (Lim. 7)
S-AM-33	G80	Min. 1.5-inch E3	Fasteners & Plates secured at a rate of 1 per 1.33 ft ²	Min. 0.5-inch SECUROCK	2-Part UIA spaced 12-inch o.c.	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-67.5 (Lim. 7)
S-AM-34	G80	Min. 1.5-inch E3	Fasteners & Plates secured at a rate of 1 per 1.33 ft ²	Min. 0.5-inch SECUROCK	2-Part UIA spaced 12-inch o.c.	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-67.5 (Lim. 7)
S-AM-35	G80	OPTIONAL Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	Min. 3/4-inch DuraBoard	UF Fasteners & Plates secured at a rate of 1 per 1.33 ft ²	TA APP Ply	-	TA APP Cap	-75 (Lim. 7)
S-AM-36	G33	Min. 2-inch E3	Fasteners & Plates secured at a rate of 1 per 1.45 ft ²	Min. 0.5-inch Retro-Fit Board or DuraBoard	Asphalt	3 plies HA BUR Ply	-	TA APP Cap	-75 (Lim. 7)
S-AM-37	G80	Min. 2-inch E3	Simultaneously fastened with Top Insulation	Min. 0.5-inch SECUROCK	JM All Purpose fasteners and OMG 3" Round Metal Plates secured at a rate of 1 per 1.78 ft ²	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-75 (Lim. 7)
S-AM-38	G80	Min. 2-inch E3	Simultaneously fastened with Top Insulation	Min. 0.5-inch SECUROCK	JM All Purpose fasteners and OMG 3" Round Metal Plates secured at a rate of 1 per 1.78 ft ²	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-75 (Lim. 7)
S-AM-39	G33	Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	Min. 0.5-inch SECUROCK	Fasteners & Plates secured at a rate of 1 per 1.45 ft ²	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-75 (Lim. 7)
S-AM-40	G33	Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	Min. 0.5-inch SECUROCK	Fasteners & Plates secured at a rate of 1 per 1.45 ft ²	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-75 (Lim. 7)
S-AM-41	G33	Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	Min. 0.5-inch DensDeck Prime or DEXcell FA	Fasteners & Plates secured at a rate of 1 per 1.45 ft ²	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-75 (Lim. 7)
S-AM-42	G33	Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	Min. 0.5-inch DensDeck Prime or DEXcell FA	Fasteners & Plates secured at a rate of 1 per 1.45 ft ²	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-75 (Lim. 7)
S-AM-43	G33	Min. 2-inch E3	Fasteners & Plates secured at a rate of 1 per 1.45 ft ²	Min. 0.5-inch SECUROCK	2-Part UIA spaced 12-inch o.c.	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-75 (Lim. 7)



Assemblies with Adhered Membranes over Insulated Steel Deck (New, Existing, or Recover)									
System No.	Deck Detail	Base Insulation	Base Insulation Attachment	Top Insulation	Top Insulation Attachment	Base Ply	Ply Sheet	Cap Sheet	MDP (psf)
S-AM-44	G33	Min. 2-inch E3	Fasteners & Plates secured at a rate of 1 per 1.45 ft ²	Min. 0.5-inch SECUROCK	2-Part UIA spaced 12-inch o.c.	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-75 (Lim. 7)
S-AM-45	G33	OPTIONAL Insulation	Simultaneously fastened with Top Insulation	Min. 2-inch E3	Fasteners & Plates secured at a rate of 20 per 4-ft x 8-ft board	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-75 (Lim. 7)
S-AM-46	G33	OPTIONAL Insulation under Min. 2-inch E3	DF secured at a rate of 20 per 4-ft x 8-ft Board	DensDeck Prime, DEXcell FA, or SECUROCK	OSFA, RSUA or 2-Part UIA ribbons spaced 6-inch o.c.	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-75 (Lim. 7)
S-AM-47	G33	OPTIONAL Insulation under Min. 2-inch E3	DF secured at a rate of 20 per 4-ft x 8-ft Board	DensDeck Prime, DEXcell FA, or SECUROCK	OSFA, RSUA or 2-Part UIA ribbons spaced 6-inch o.c.	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-75 (Lim. 7)
S-AM-48	G33	Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	Min. 0.5-inch DensDeck Prime	Fasteners & Plates secured at a rate of 16 per 4-ft x 8-ft Board	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-75 (Lim.7)
S-AM-49	G33	Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	Min. 0.5-inch DensDeck Prime	Fasteners & Plates secured at a rate of 16 per 4-ft x 8-ft Board	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-75 (Lim.7)

Mechanically Fastened Assemblies over Steel Deck (New, Existing, or Recover)							
System No.	Deck Detail	Insulation	Base Sheet	Base Sheet Attachment	Ply Sheet	Cap Sheet	MDP (psf)
S-M-1	G33	Min. 1-inch E3 Preliminarily Secured	DynaFast 1	HL Fasteners & Plates spaced 6-inch o.c. in every other lap within the 4-inch wide heat welded side laps in row spaced max. 70-inches	OPTIONAL TA SBS Ply	TA APP Cap	-52.5 (Lim. 7)
S-M-2	G33	Min. 1.5-inch E3 Preliminarily Secured	DynaFast 2	HL Fasteners & Plates spaced 12-inch o.c. within the 4-inch wide heat welded side laps	OPTIONAL TA SBS Ply	TA APP Cap	-67.5 (Lim. 7)
S-M-3	G33	Min. 1-inch E3 Preliminarily Secured	DynaFast 2	Batten Bar spaced 6-inch o.c. within the 4-inch wide heat welded side laps in row spaced max. 71-inches	OPTIONAL TA SBS Ply	TA APP Cap	-90 (Lim. 7)
S-M-4	G50	Min. 1.5-inch E3 Preliminarily Secured	DynaFast 2	APB Fasteners & Plates or HL Fasteners & Plates spaced 6-inch o.c within 4-inch heat welded side laps	OPTIONAL TA SBS Ply	TA APP Cap	-105 (Lim. 7)



Mechanically Fastened Assemblies over <i>Steel Deck (New, Existing, or Recover)</i>							
System No.	Deck Detail	Insulation	Base Sheet	Base Sheet Attachment	Ply Sheet	Cap Sheet	MDP (psf)
S-M-5	G80	Min. 1-inch E3 Preliminarily Secured	DynaFast 2	HL Fasteners & Plates spaced 6-inch o.c. within the 4-inch wide heat welded side laps	OPTIONAL TA SBS Ply	TA APP Cap	-105 (Lim. 7)

Assemblies with All Layers Adhered over <i>Wood Deck (New or Existing)</i>							
System No.	Deck Detail	Base Insulation (Note 6)	Top Insulation	Base Ply	Ply Sheet	Cap Sheet	MDP (psf)
W-A-1	T15/32P, L24	Min. 1.5-inch ENRGY 3 applied in JM UA or RSUA 12-inch o.c.	-	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 9)
W-A-2	7/160, L24	-	Min. 0.5-inch DEXcell FA, DensDeck Prime, Protector HD or SECUROCK applied in JM UA, 2-Part UIA or RSUA 12-inch o.c.	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 9)
W-A-3	7/160, L24	-	Protector HD applied in JM UA, 2-Part UIA or RSUA 12-inch o.c.	BA APP Ply or CA APP Ply	OPTIONAL BA APP Ply or CA APP Ply	BA APP Cap or CA APP Cap	-45 (Lim. 9)
W-A-4	7/160, L24	-	Min. 0.5-inch DEXcell FA, DensDeck Prime, or SECUROCK applied in JM UA, 2-Part UIA or RSUA 12-inch o.c.	CA APP Ply or TA APP Ply	OPTIONAL CA APP Ply or TA APP Ply	CA APP Cap or TA APP Cap	-45 (Lim. 9)
W-A-5	7/160, L24	Min. 1.5-inch ENRGY 3 applied in JM UA, 2-Part UIA or RSUA 12-inch o.c.	Min. 0.5-inch DEXcell FA, DensDeck Prime, or SECUROCK applied in JM UA, 2-Part UIA or RSUA 12-inch o.c.	CA APP Ply or TA APP Ply	OPTIONAL CA APP Ply or TA APP Ply	CA APP Cap or TA APP Cap	-45 (Lim. 9)
W-A-6	7/160, L24	Min. 1.5-inch ENRGY 3 applied in JM UA, 2-Part UIA or RSUA 12-inch o.c.	Protector HD applied in JM UA, 2-Part UIA or RSUA 12-inch o.c.	BA APP Ply or CA APP Ply	OPTIONAL BA APP Ply or CA APP Ply	BA APP Cap or CA APP Cap	-45 (Lim. 9)
W-A-7	7/160, L24	Min. 1.5-inch ENRGY 3 applied in JM UA, 2-Part UIA or RSUA 12-inch o.c.	Min. 0.5-inch DEXcell FA, DensDeck Prime, Protector HD or SECUROCK applied in JM UA, 2-Part UIA or RSUA 12-inch o.c.	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 9)
W-A-8	7/160, L24	Min. 1.5-inch ENRGY 3 applied in JM UA, 2-Part UIA or RSUA 12-inch o.c.	-	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 9)
W-A-9	T15/32P, L24	Min. 1.5-inch ENRGY 3 applied in JM UA 6-inch o.c.	DEXcell FA applied in JM UA 6-inch o.c.	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-75 (Lim.7)



Assemblies with All Layers Adhered over Wood Deck (New or Existing)							
System No.	Deck Detail	Base Insulation (Note 6)	Top Insulation	Base Ply	Ply Sheet	Cap Sheet	MDP (psf)
W-A-10	T7/160, L24	Min. 1.5-inch ENRGY 3 applied in JM UA 6-inch o.c.	-	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-75 (Lim.7)
W-A-11	T7/160, L24	-	DEXcell FA or DensDeck Prime applied in JM UA 6-inch o.c.	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-75 (Lim.7)
W-A-12	T7/160, L24	-	DEXcell FA or DensDeck Prime applied in JM UA 6-inch o.c.	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-82.5 (Lim.7)

Assemblies with Adhered Membranes over Insulated Wood Deck (New, Existing, or Recover)									
System No.	Deck Detail	Anchor Sheet	Anchor Attachment	Base Insulation	Top Insulation	Base Ply	Ply Sheet	Cap Sheet	MDP (psf)
W-AM-1	T7/160, L24	-	-	OPTIONAL Insulation	Min. 1.5-inch E3 fastened with Trufast VERSA-FAST fastener and UltraFast 3" Round Metal Plate secured 12 per 4-ft x 8-ft board	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-30 (Lim. 7)
W-AM-2	T7/160, L24	-	-	OPTIONAL Insulation	Min. 1.5-inch E3 fastened with Trufast VERSA-FAST fastener and UltraFast 3" Round Metal Plate secured 12 per 4-ft x 8-ft board	CA APP Ply	OPTIONAL CA APP Ply	CA APP Cap	-30 (Lim. 7)
W-AM-3	T7/160 or T15/32P, L24	-	-	OPTIONAL Insulation under min. 1.5-inch E3 fastened with UF secured at a rate of 16 per 4-ft x 8-ft Board	DensDeck Prime, DEXcell FA, or SECUROCK adhered with JM UA, OSFA, RSUA or 2-Part UIA spaced 12-inch o.c.	CA APP Ply or TA APP Ply	OPTIONAL CA APP Ply or TA APP Ply	CA APP Cap or TA APP Cap	-37.5 (Lim.7)
W-AM-4	T7/160 or T15/32P, L24	-	-	OPTIONAL Insulation under min. 1.5-inch E3	DEXcell FA fastened with UF secured at a rate of 15 per 4-ft x 8-ft Board.	CA APP Ply or TA APP Ply	OPTIONAL CA APP Ply or TA APP Ply	CA APP Cap or TA APP Cap	-37.5 (Lim.7)



Assemblies with Adhered Membranes over Insulated Wood Deck (New, Existing, or Recover)									
System No.	Deck Detail	Anchor Sheet	Anchor Attachment	Base Insulation	Top Insulation	Base Ply	Ply Sheet	Cap Sheet	MDP (psf)
W-AM-5	T7/160, L24	-	-	OPTIONAL Insulation	DensDeck Prime fastened with Trufast VERSA-FAST fastener and UltraFast 3" Round Metal Plate secured 12 per 4-ft x 8-ft board	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-37.5 (Lim. 7)
W-AM-6	T7/160, L24	-	-	OPTIONAL Insulation	DensDeck Prime fastened with Trufast VERSA-FAST fastener and UltraFast 3" Round Metal Plate secured 12 per 4-ft x 8-ft board	CA APP Ply	OPTIONAL CA APP Ply	CA APP Cap	-37.5 (Lim. 7)
W-AM-7	T7/160, 24	PermaPly 28	RS Nails & Tin Tags spaced 8-inch o.c. in the 3-inch side laps and 8-inch o.c. in two rows in the field of the roll	Min. 1.5-inch E3 adhered with RSUA applied 12-inch o.c.	OPTIONAL Min. 1.5-inch E3 adhered with RSUA applied 12-inch o.c.	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-37.5 (Lim.7)
W-AM-8	T7/160, 24	PermaPly 28	RS Nails & Tin Tags spaced 8-inch o.c. in the 3-inch side laps and 8-inch o.c. in two rows in the field of the roll	Min. 1.5-inch E3 adhered with RSUA applied 12-inch o.c.	DensDeck Prime, DEXcell FA, or SECUROCK adhered with OSFA, RSUA, or 2-Part UIA applied 12-inch o.c.	CA APP Ply or TA APP Ply	OPTIONAL CA APP Ply or TA APP Ply	CA APP Cap or TA APP Cap	-37.5 (Lim.7)
W-AM-9	T7/160, 24	PermaPly 28	RS Nails & Tin Tags spaced 8-inch o.c. in the 3-inch side laps and 8-inch o.c. in two rows in the field of the roll	Min. 1.5-inch E3 adhered with RSUA applied 12-inch o.c.	DensDeck Prime, DEXcell FA, or SECUROCK adhered with OSFA, RSUA, or 2-Part UIA applied 12-inch o.c.	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-37.5 (Lim.7)
W-AM-10	T7/160 or T15/32P, L24	-	-	OPTIONAL INSULATION under min. 1.5-inch E3 or E3 C1 secured with JM High Load Fasteners and UltraFast Plates at a rate of 16 per 4-ft x 8-ft board	DensDeck Prime, DEXcell FA, or SECUROCK adhered with JM UA, OSFA, RSUA, or 2-Part UIA applied 12-inch o.c.	CA APP Ply or TA APP Ply	OPTIONAL CA APP Ply or TA APP Ply	CA APP Cap or TA APP Cap	-45 (Lim.7)



Assemblies with Adhered Membranes over Insulated Wood Deck (New, Existing, or Recover)									
System No.	Deck Detail	Anchor Sheet	Anchor Attachment	Base Insulation	Top Insulation	Base Ply	Ply Sheet	Cap Sheet	MDP (psf)
W-AM-11	T15/32P, L24	-	-	OPTIONAL Min. 0.5-inch E3	Min. 2-inch ENRGY or ENRGY 3 CGF 3 fastened with Fasteners & Plates secured at a rate of 16 per 4-ft x 8-ft Board	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-52.5 (Lim. 7)
W-AM-12	T15/32P, L24	-	-	OPTIONAL Insulation and/or Vapor Barrier	Min. 2-inch E3 fastened with Fasteners & Plates secured 16 per 4-ft x 8-ft board	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-52.5 (Lim. 7)
W-AM-13	T15/32P, L24	-	-	OPTIONAL Insulation	DensDeck Prime fastened with HL & UF Plates secured at a rate of 16 per 4-ft x 8-ft Board	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-52.5 (Lim.7)
W-AM-14	T15/32P, L24	-	-	OPTIONAL Insulation	DensDeck Prime fastened with HL & UF Plates secured at a rate of 16 per 4-ft x 8-ft Board	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-52.5 (Lim.7)
W-AM-15	T15/32P, L24	-	-	OPTIONAL Insulation and/or Vapor Barrier	Min. 2-inch E3 fastened with Fasteners & Plates secured 24 per 4-ft x 8-ft board	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-75 (Lim. 7)
W-AM-16	T15/32P, L24	-	-	OPTIONAL Insulation	Min. 0.5-inch DEXcell FA fastened with AP & UF Plates secured at a rate of 24 per 4-ft x 8-ft Board	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-75 (Lim.7)
W-AM-17	T15/32P, L24	-	-	OPTIONAL Insulation	Min. 0.5-inch DEXcell FA fastened with AP & UF Plates secured at a rate of 24 per 4-ft x 8-ft Board	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-75 (Lim.7)



Assemblies with Adhered Membranes over Insulated Wood Deck (New, Existing, or Recover)									
System No.	Deck Detail	Anchor Sheet	Anchor Attachment	Base Insulation	Top Insulation	Base Ply	Ply Sheet	Cap Sheet	MDP (psf)
W-AM-18	T15/32P, L24	-	-	OPTIONAL Insulation	Min. 0.5-inch DensDeck Prime fastened with HL & UF Plates secured at a rate of 16 per 4-ft x 8-ft Board	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-75 (Lim.7)
W-AM-19	T15/32P, L24	-	-	OPTIONAL Insulation	Min. 0.5-inch DensDeck Prime fastened with HL & UF Plates secured at a rate of 16 per 4-ft x 8-ft Board	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-75 (Lim.7)
W-AM-20	T19/32P, L24	-	-	OPTIONAL Insulation	Min. 0.5-inch DensDeck Prime fastened with Fasteners & Plates secured at a rate of 16 per 4-ft x 8-ft Board	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-75 (Lim.7)
W-AM-21	T19/32P, L24	-	-	OPTIONAL Insulation	Min. 0.5-inch DensDeck Prime fastened with Fasteners & Plates secured at a rate of 16 per 4-ft x 8-ft Board	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-75 (Lim.7)
W-AM-22	T15/32P, L24	-	-	OPTIONAL Insulation	Min. 0.5-inch DensDeck Prime fastened with Fasteners & Plates secured at a rate of 24 per 4-ft x 8-ft Board	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-75 (Lim.7)
W-AM-23	T19/32P, L24	-	-	OPTIONAL Insulation	Min. 0.5-inch DEXcell FA fastened with AP & UF Plates secured at a rate of 24 per 4-ft x 8-ft Board	SA Base	OPTIONAL TA APP Ply	TA APP Cap	-75 (Lim.7)



Assemblies with Adhered Membranes over Insulated Wood Deck (New, Existing, or Recover)									
System No.	Deck Detail	Anchor Sheet	Anchor Attachment	Base Insulation	Top Insulation	Base Ply	Ply Sheet	Cap Sheet	MDP (psf)
W-AM-24	T15/32P, L24	-	-	OPTIONAL Insulation	Min. 0.5-inch DensDeck Prime fastened with Fasteners & Plates secured at a rate of 24 per 4-ft x 8-ft Board	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-82.5 (Lim.7)
W-AM-25	T19/32P, L24	-	-	OPTIONAL Insulation	Min. 0.5-inch DEXcell FA fastened with AP & UF Plates secured at a rate of 24 per 4-ft x 8-ft Board	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-82.5 (Lim.7)

Mechanically Fastened Assemblies over Wood Deck (New, Existing, or Recover)								
System No.	Deck Detail	Fire Barrier	Insulation	Base Sheet	Base Sheet Attachment	Ply Sheet	Cap Sheet	MDP (psf)
W-M-1	T7/160, L24	-	-	MA Base	Tape & Staple spaced 9-inch o.c. at the 2-inch side laps and 9-inch o.c. in three (3) rows in the field of the roll	OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 7)
W-M-2	T15/32P, L24	-	-	MA Base	UF Fasteners & Plates (Square) spaced 9-inch o.c. at the 4-inch side laps and 12-inch o.c. in two (2) rows staggered in field of the roll	OPTIONAL TA APP Ply	TA APP Cap	-52.5 (Lim. 7)
W-M-3	T15/32P, L24	OPTIONAL Any approved fire barrier	Min. 1.5-inch E3 Preliminarily Secured	DynaFast 2 above OPTIONAL FB	APB Fasteners & Plates or HL Fasteners & Plates spaced 9-inch o.c within 4-inch heat welded side laps	OPTIONAL TA SBS Ply	TA APP Cap	-60 (Lim. 7)
W-M-4	T15/32P, L24	OPTIONAL Any approved fire barrier	Min. 1.5-inch E3 Preliminarily Secured	DynaFast 2 above OPTIONAL FB	Batten Bar spaced 6-inch o.c. within the 4-inch wide heat welded side laps	OPTIONAL TA SBS Ply	TA APP Cap	-82.5 (Lim. 7)

END OF REPORT